

TIGHTENING TORQUE FOR TERMINAL BLOCK IS 9 in-lbs.


MODEL NO.

SSC2BB

PAGE

1

# CONNECTION DIAGRAM

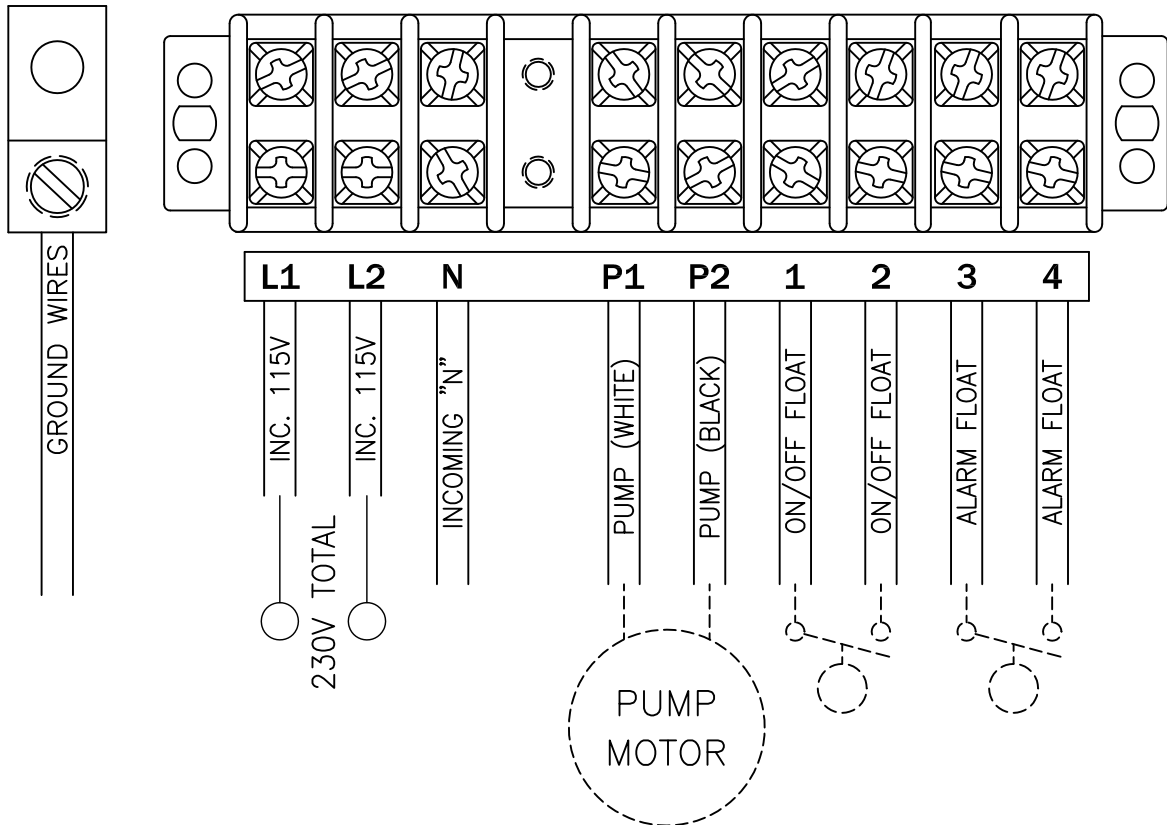

ALL INFORMATION CONTAINED IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS INC.



CHANGES	TOLERANCES	DRAWN BY	DATE	CONNECTION DIAGRAM 230V BIO SIMPLEX	
F	DECIMALS .XXX = ±.005 .XX = ±.010 FRACTIONAL X/X = ±.1/64 ANGLES X° = ±1/2°	C. BARRICK	03/30/09		
E		MATERIAL SPECIFICATION:  AS NOTED		FULL	50A002B
D					
C					
B					
A					


POWER CIRCUIT  
230V - 1PH

NOTE: PUMP MOTOR MUST HAVE  
INTERNAL OVERLOAD PROTECTION.

MODEL NO.

SSC2BB

PAGE  
2

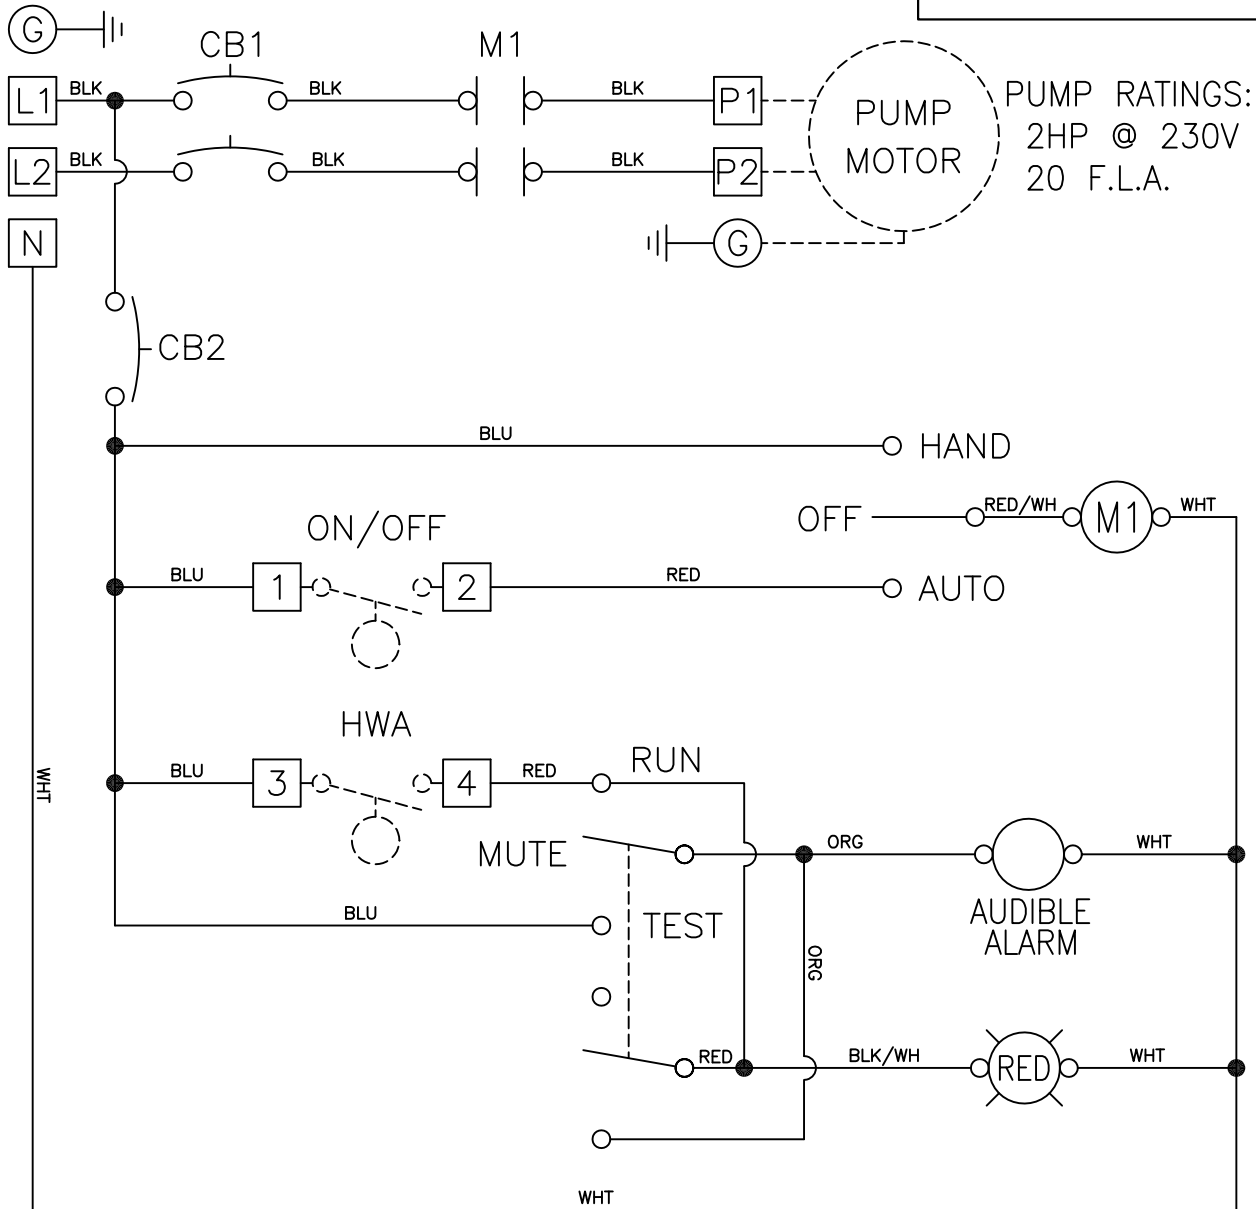

NOTES: MAIN PANEL DISCONNECT MUST BE PROVIDED BY INSTALLER.  
DASHED LINES INDICATE ITEMS NOT CONTAINED IN THE PANEL.  
FIELD WIRING MUST BE A MINIMUM OF 60°C COPPER WIRE.  
REQUIRED TORQUE FOR TERMINAL BLOCK SCREWS IS 9 in-lbs.  
TO PRESERVE ENVIRONMENTAL RATING OF PANEL, USE FITTINGS  
AND HUBS WITH SAME ENVIRONMENTAL RATING AS ENCLOSURE.



ALL INFORMATION CONTAINED IN THIS DRAWING IS  
CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS INC.

CHANGES	TOLERANCES	DRAWN BY	DATE	SCHEMATIC, ELECTRICAL	
F	DECIMALS .XXX = ±.005 .XX = ±.010 FRACTIONAL X/X = ±.1/64 ANGLES x° = ±1/2°	C. BARRICK	03/30/09	SCALE:	PART NO.
E		MATERIAL SPECIFICATION:  AS NOTED		FULL	50A002B
D					
C					
B					
A					