

# CONNECTION DIAGRAM


MODEL NO.

10


PAGE

1

TIGHTENING TORQUE FOR TERMINAL BLOCK IS 16 in-lbs.

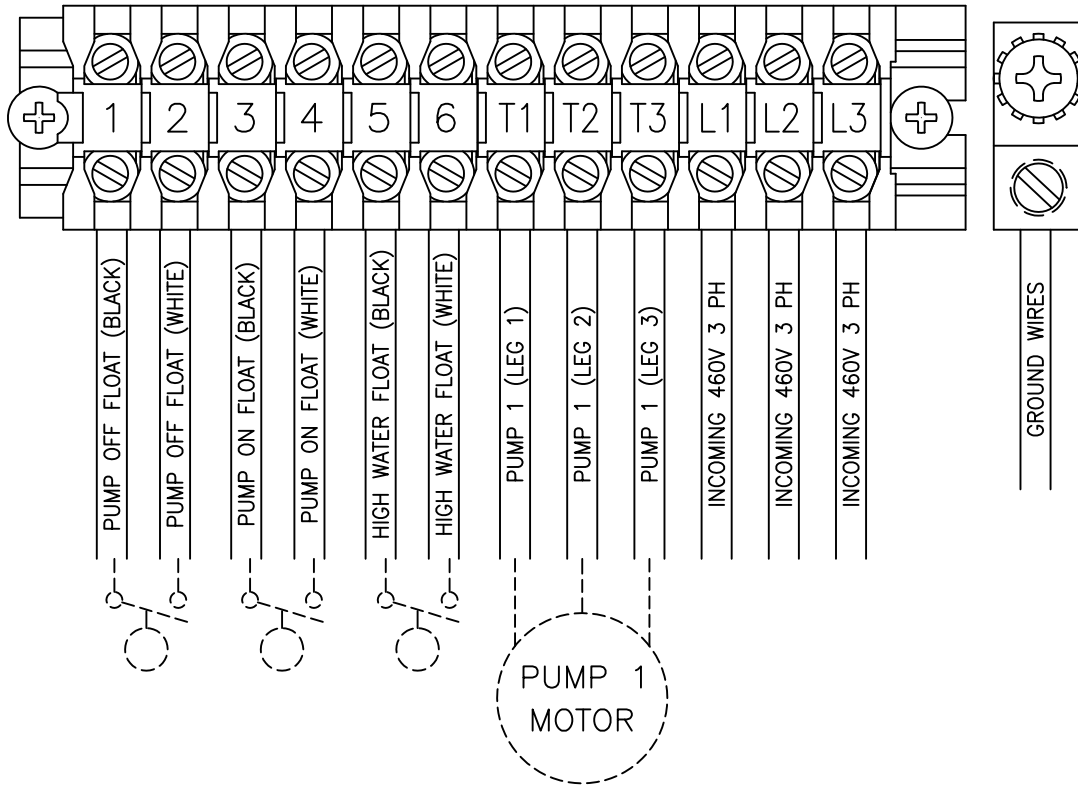

**WARNING:**  
 TRANSFORMER WIRES MUST BE CONFIGURED AS PER THE INCOMING VOLTAGE. ALL 3-PHASE PANELS ARE TESTED USING 230V AND MAY REQUIRE RECONFIGURATION.

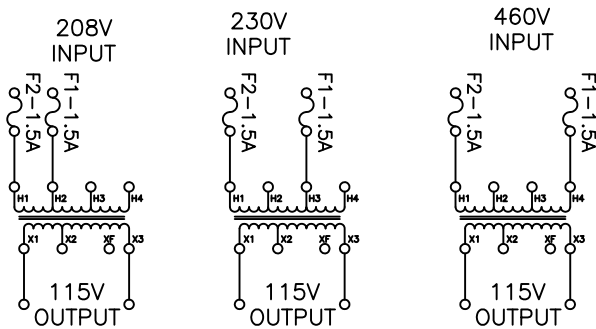


ALL INFORMATION CONTAINED IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS INC.



CHANGES		TOLERANCES		DRAWN BY		DATE		TERMINAL CONNECTIONS		
F		DECIMALS .XXX = ±.005 .XX = ±.010 FRACTIONAL X/X = ±.1/64 ANGLES X° = ±1/2°		C. BARRICK		11/5/2018				
E				MATERIAL SPECIFICATION:						
D				AS NOTED				SCALE:	PART NO.	
C								FULL	50A008	
B										
A										

POWER CIRCUIT (3 WIRE SERVICE)  
460V - 3PH - 60Hz

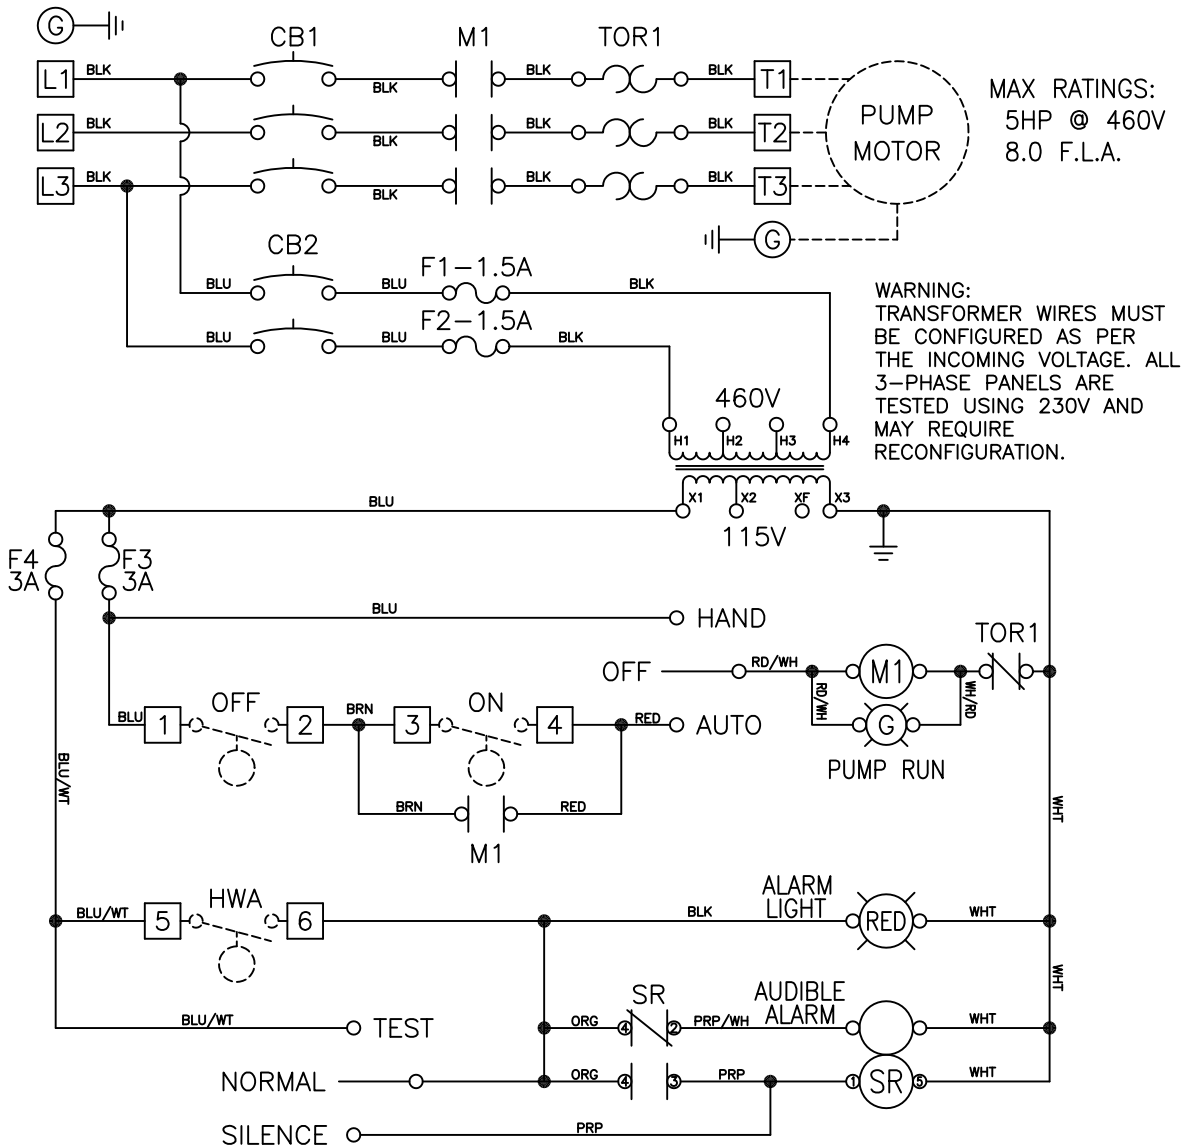

NOTES: FLOAT SWITCH TO BE RATED 2 AMP AT 120V MINIMUM.  
MAIN PANEL DISCONNECT MUST BE PROVIDED BY INSTALLER.  
DASHED LINES INDICATE ITEMS NOT CONTAIN IN THE PANEL.  
REQUIRED TORQUE FOR TERMINAL BLOCK SCREWS IS 16 in-lbs.  
FIELD WIRING MUST BE A MINIMUM OF 60°C COPPER WIRE.

ALL INFORMATION CONTAINED IN THIS DRAWING IS  
CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS INC.



CHANGES	TOLERANCES	DRAWN BY	DATE	SCHEMATIC, ELECTRICAL	
F	DECIMALS .XXX = ±.005 .XX = ±.010 FRACTIONAL X/X = ±.1/64 ANGLES X° = ±1/2°	C. BARRICK	11/5/2018	SCALE:	PART NO.
E		MATERIAL SPECIFICATION:  AS NOTED		FULL	50A008
D					
C					
B					
A					