


TIGHTENING TORQUE FOR TERMINAL BLOCK IS 9 in-lbs.

MODEL NO.


SDC2BB

PAGE

1

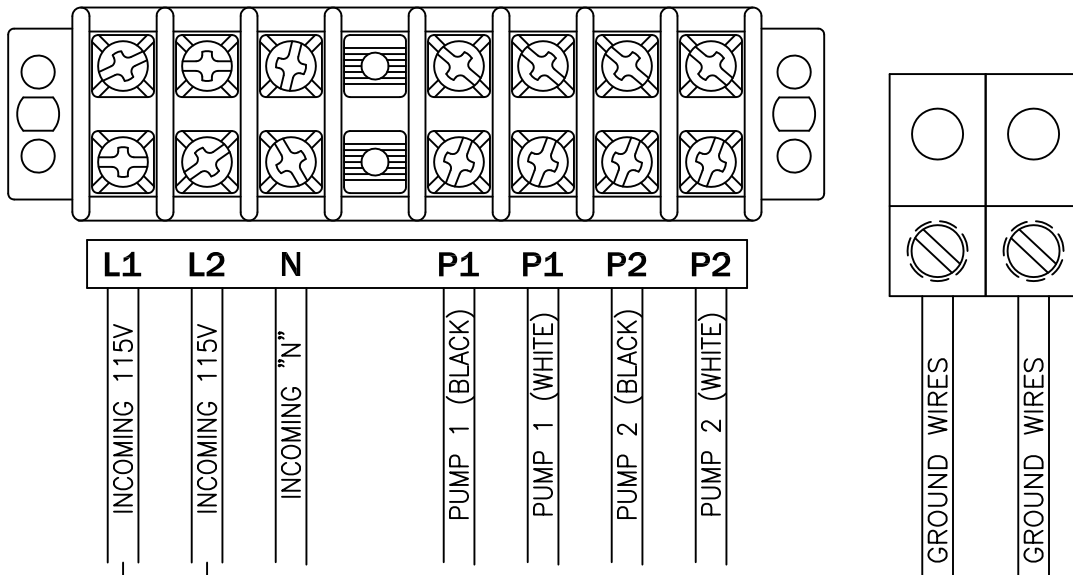

230V TOTAL

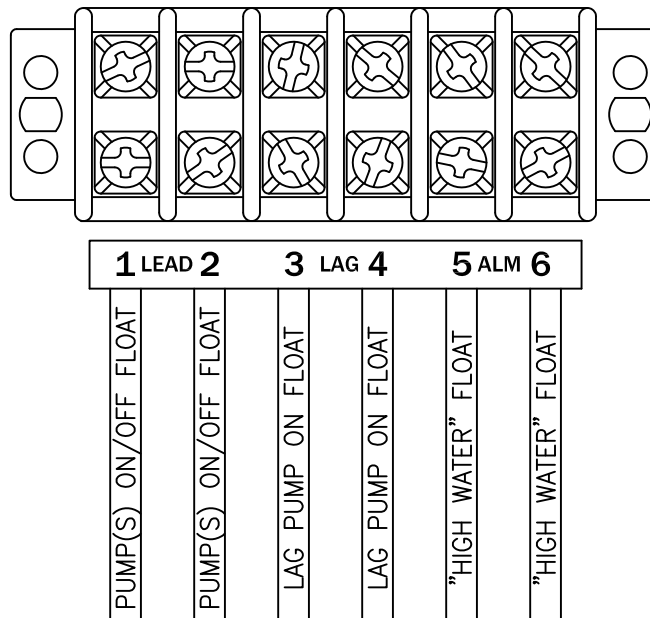

ALL INFORMATION CONTAINED IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS INC.




CHANGES	TOLERANCES	DRAWN BY	DATE
F	DECIMALS .xxx = ±.005	C. BARRICK	12/18/17
E	.xx = ±.010	MATERIAL SPECIFICATION: AS NOTED	
D	FRACTIONAL		
C	x/x = ±.1/64		
B	ANGLES		
A	x' = ±1/2"		


CONNECTION DIAGRAM	
SCALE:	PART NO.
FULL	50A502B

POWER CIRCUIT
230V - 1PH

NOTE: PUMP MOTORS MUST HAVE
INTERNAL OVERLOAD PROTECTION.

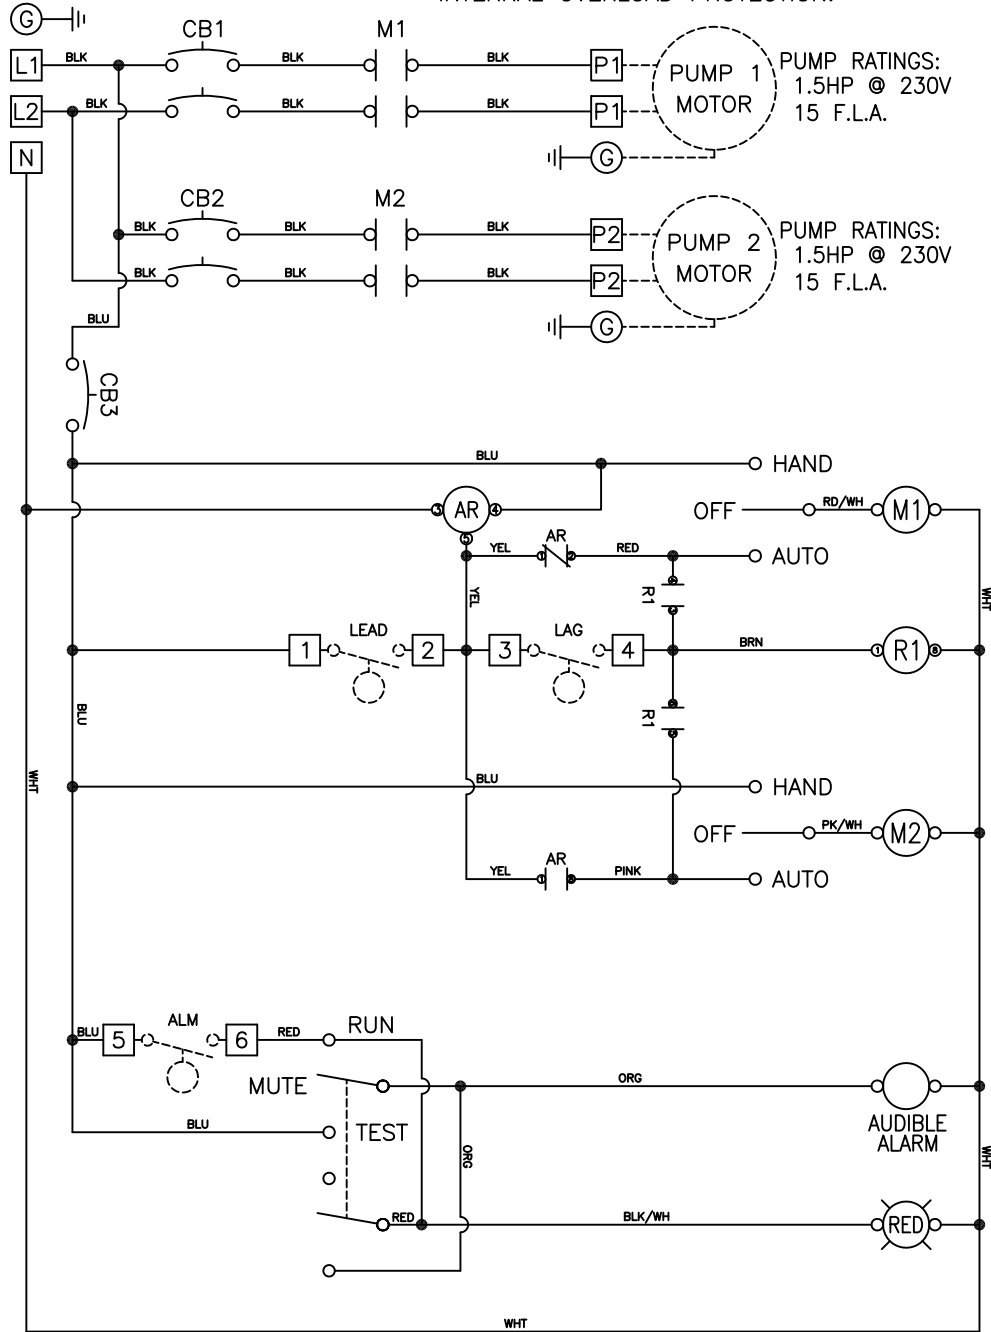

NOTES: MAIN PANEL DISCONNECT MUST BE PROVIDED BY INSTALLER.
DASHED LINES INDICATE ITEMS NOT CONTAINED IN THE PANEL.
REQUIRED TORQUE FOR TERMINAL BLOCK SCREWS IS 9 in-lbs.
FIELD WIRING MUST BE A MINIMUM OF 60°C COPPER WIRE.
ALL INFORMATION CONTAINED IN THIS DRAWING IS CONFIDENTIAL
AND PROPRIETARY TO SEPTIC PRODUCTS INC.



SPI
SEPTIC PRODUCTS INC

SCHEMATIC, ELECTRICAL	
SCALE: FULL	PART NO. 50A502B

CHANGES	TOLERANCES	DRAWN BY	DATE
F	DECIMALS .XXX = ±.005 .XX = ±.010	C. BARRICK	12/28/17
E	FRACTIONAL X/X = ±.1/64 ANGLES X' = ±1/2'	MATERIAL SPECIFICATION:	
D		AS NOTED	
C			
B			
A			