



POWER CIRCUIT
230V - 1PH

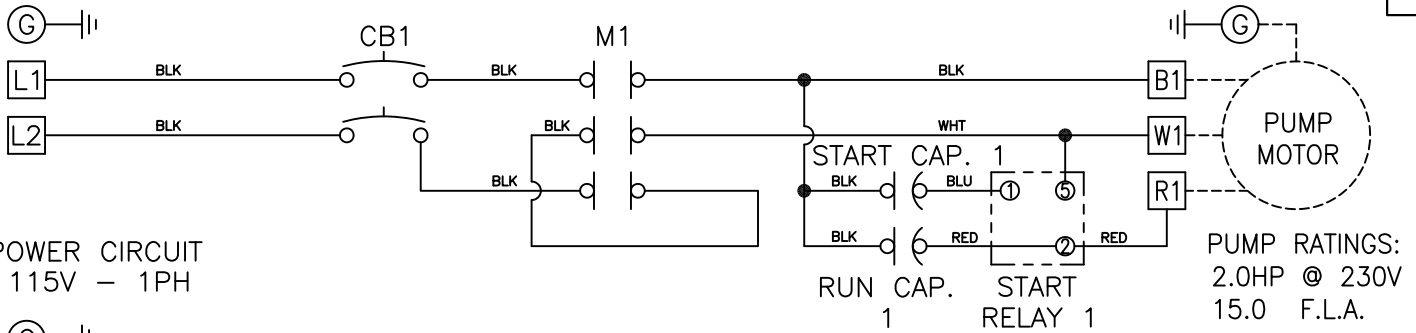

POWER CIRCUIT
115V - 1PH

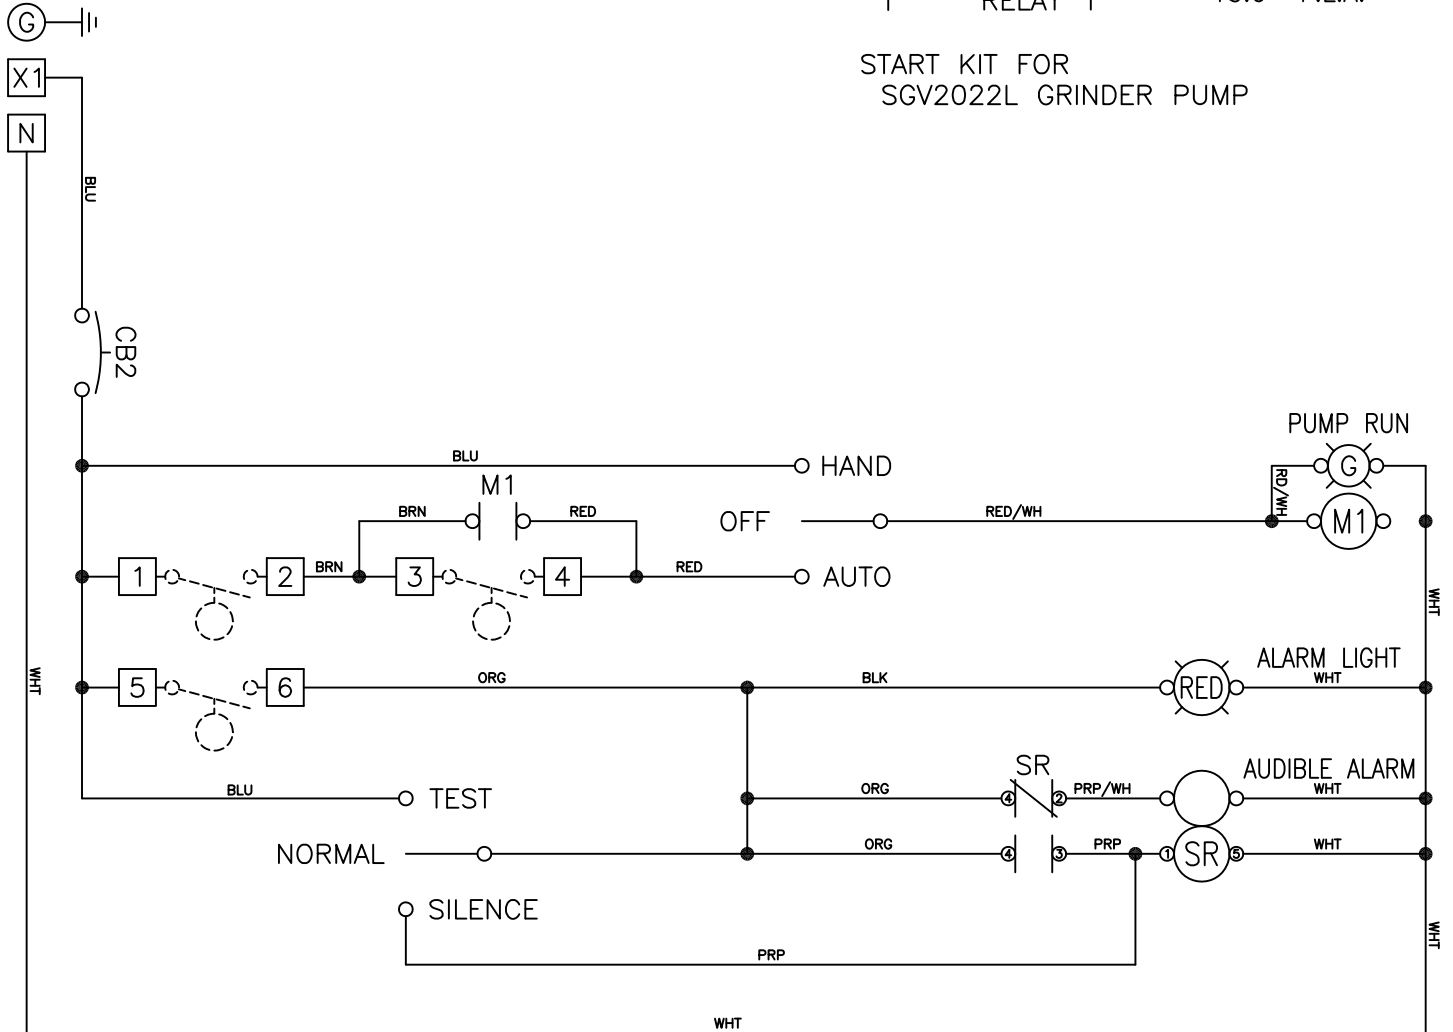

START KIT FOR
SGV2022L GRINDER PUMP

NOTES: FLOAT SWITCH TO BE RATED 2 AMP AT 120V MINIMUM.
MAIN PANEL DISCONNECT MUST BE PROVIDED BY INSTALLER.
DASHED LINES INDICATE ITEMS NOT CONTAINED IN THE PANEL.
REQUIRED TORQUE FOR TERMINAL BLOCK SCREWS IS 16 in-lbs.
FIELD WIRING MUST BE A MINIMUM OF 60°C COPPER WIRE.




CHANGES	TOLERANCES	DRAWN BY	DATE
F	DECIMALS .XXX = ±.005	C. BARRICK	10/7/2013
E	.XX = ±.010	MATERIAL SPECIFICATION: AS NOTED	
D	FRACTIONAL		
C	X/X = ±.1/64		
B	ANGLES		
A	X° = ±1/2°		

SCHEMATIC, ELECTRICAL

SCALE: PART NO.
FULL 50A700


MODEL NO.
C20-SGV2022L

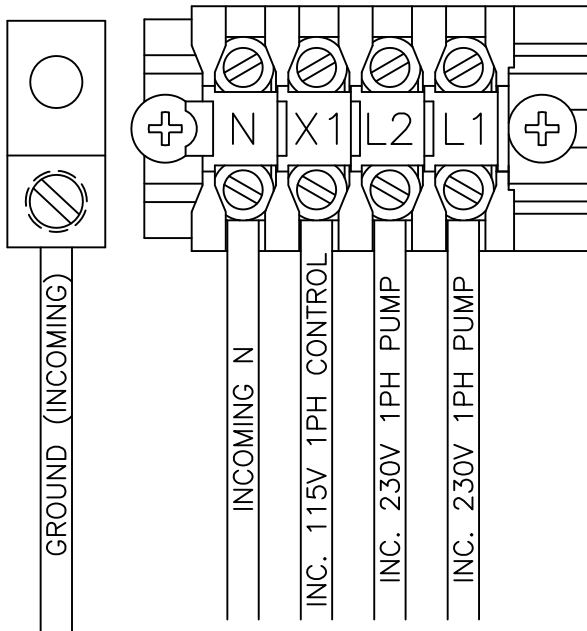

INCOMING POWER CONNECTION

PUMP & FLOAT CONNECTIONS

TIGHTENING TORQUE FOR TERMINAL BLOCK IS 16 in-lbs.

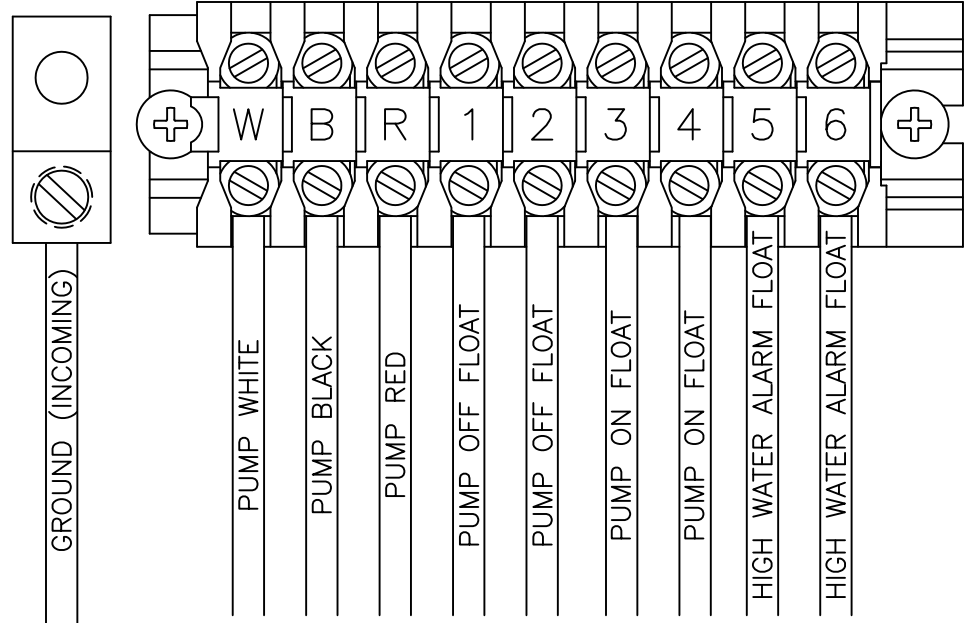

CHANGES	TOLERANCES	DRAWN BY	DATE	POWER CONNECTION DIAGRAM SIMPLEX(230V)		
F	DECIMALS .XXX = ±.005 .XX = ±.010 FRACTIONAL X/X = ±.1/64 ANGLES X° = ±1/2°	C. BARRICK	10/7/2013			SCALE:
E		MATERIAL SPECIFICATION: AS NOTED			FULL	50A700
D						
C						
B						
A						