

TIGHTENING TORQUE FOR TERMINAL BLOCK IS 9 in-lbs.


MODEL NO.

D

PAGE

1

CONNECTION DIAGRAM

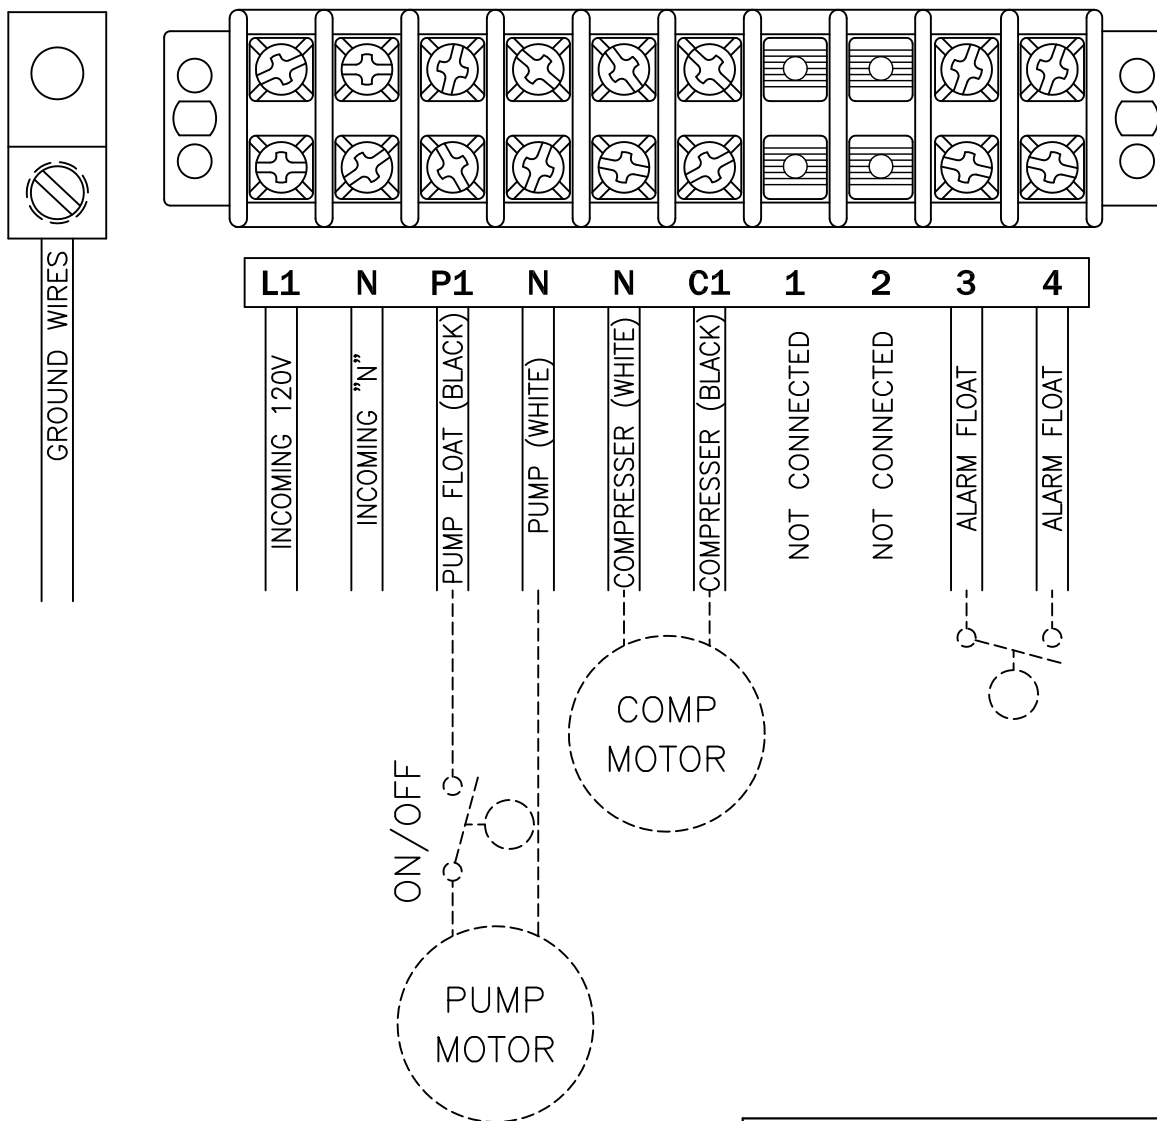

ALL INFORMATION CONTAINED IN THIS DRAWING IS
CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS INC.



| CHANGES | TOLERANCES | DRAWN BY | DATE | POWER CONNECTION DIAGRAM | |
|---------|---|---|---------|------------------------------------|--|
| F | DECIMALS .XXX = ± 0.005 .XX = ± 0.010 FRACTIONAL X/X = $\pm 1/64$ ANGLES X° = $\pm 1/2^\circ$ | D. MIDDLETON | 5/20/04 | | |
| E | | MATERIAL SPECIFICATION: AS NOTED | | SCALE: PART NO. FULL 50B007 | |
| D | | | | | |
| C | | | | | |
| B | | | | | |
| A | | | | | |


PUMP/COMPRESSOR POWER CIRCUIT 115V – 1PH

MODEL NO.

D

PAGE
2

NOTE: BOTH MOTORS MUST HAVE
INTERNAL OVERLOAD PROTECTION.

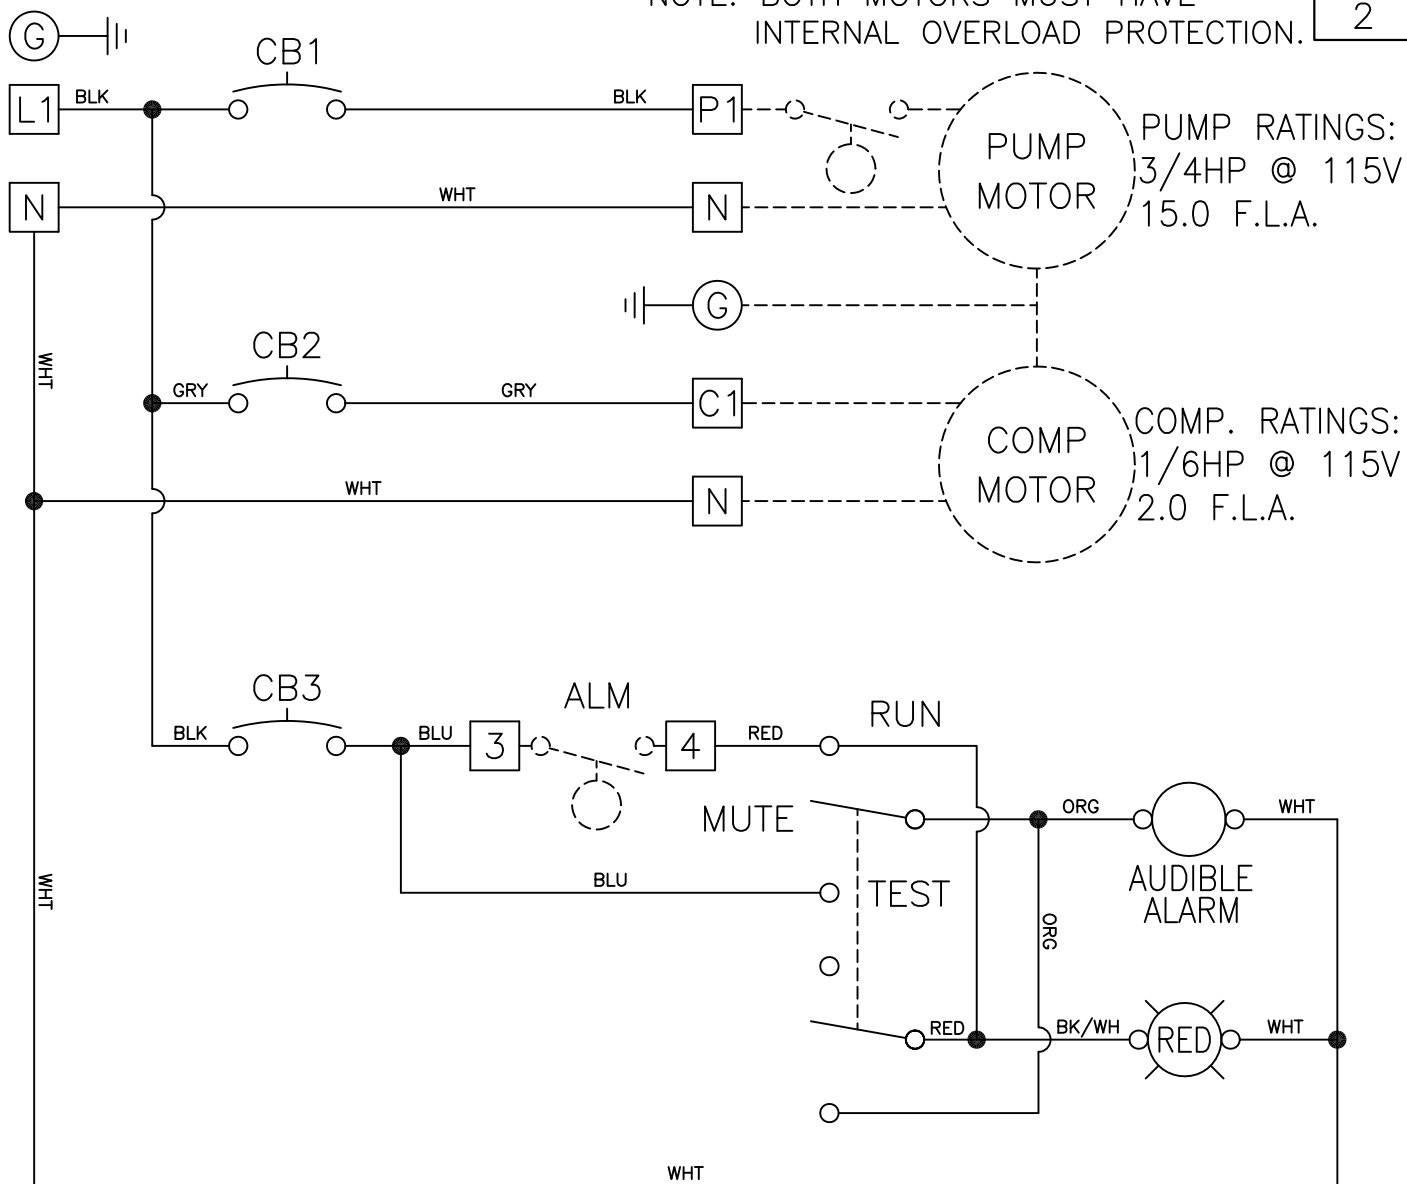

NOTES: MAIN PANEL DISCONNECT MUST BE PROVIDED BY INSTALLER.
DASHED LINES INDICATE ITEMS NOT CONTAINED IN THE PANEL.
FIELD WIRING MUST BE A MINIMUM OF 60°C COPPER WIRE.
REQUIRED TORQUE FOR TERMINAL BLOCK SCREWS IS 9 in-lbs.

ALL INFORMATION CONTAINED IN THIS DRAWING IS
CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS, INC.



| CHANGES | TOLERANCES | DRAWN BY | DATE | SCHEMATIC, ELECTRICAL W/O TIMER | |
|---------|--------------|---|----------|------------------------------------|----------|
| F | DECIMALS | D. MIDDLETON | 06/20/04 | SCALE: | PART NO. |
| E | .XXX = ±.005 | MATERIAL SPECIFICATION: AS NOTED | | FULL | 50B007 |
| D | .XX = ±.010 | | | | |
| C | FRACTIONAL | | | | |
| B | X/X = ±.1/64 | | | | |
| A | ANGLES | | | | |
| | X° = ±1/2° | | | | |