


TIGHTENING TORQUE FOR TERMINAL BLOCK IS 9 in-lbs.

MODEL NO.

HWAP


PAGE
1

CONNECTION DIAGRAM

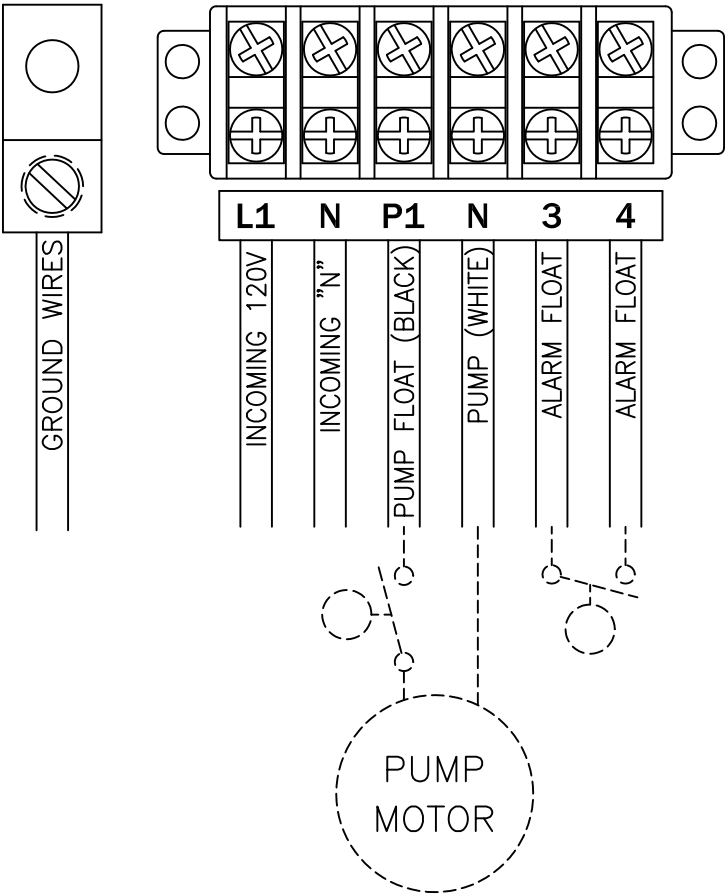

CHANGES		TOLERANCES	DRAWN BY	DATE	POWER CONNECTION DIAGRAM	
F		DECIMALS .XXX = ±.005 .XX = ±.010 FRACTIONAL X/X = ±.1/64 ANGLES X° = ±1/2°	D. MIDDLETON	5/20/04		
E			MATERIAL SPECIFICATION: AS NOTED		SCALE:	PART NO.
D					FULL	50B010
C						
B						
A						

NOTE: MOTOR MUST HAVE INTERNAL OVERLOAD PROTECTION.

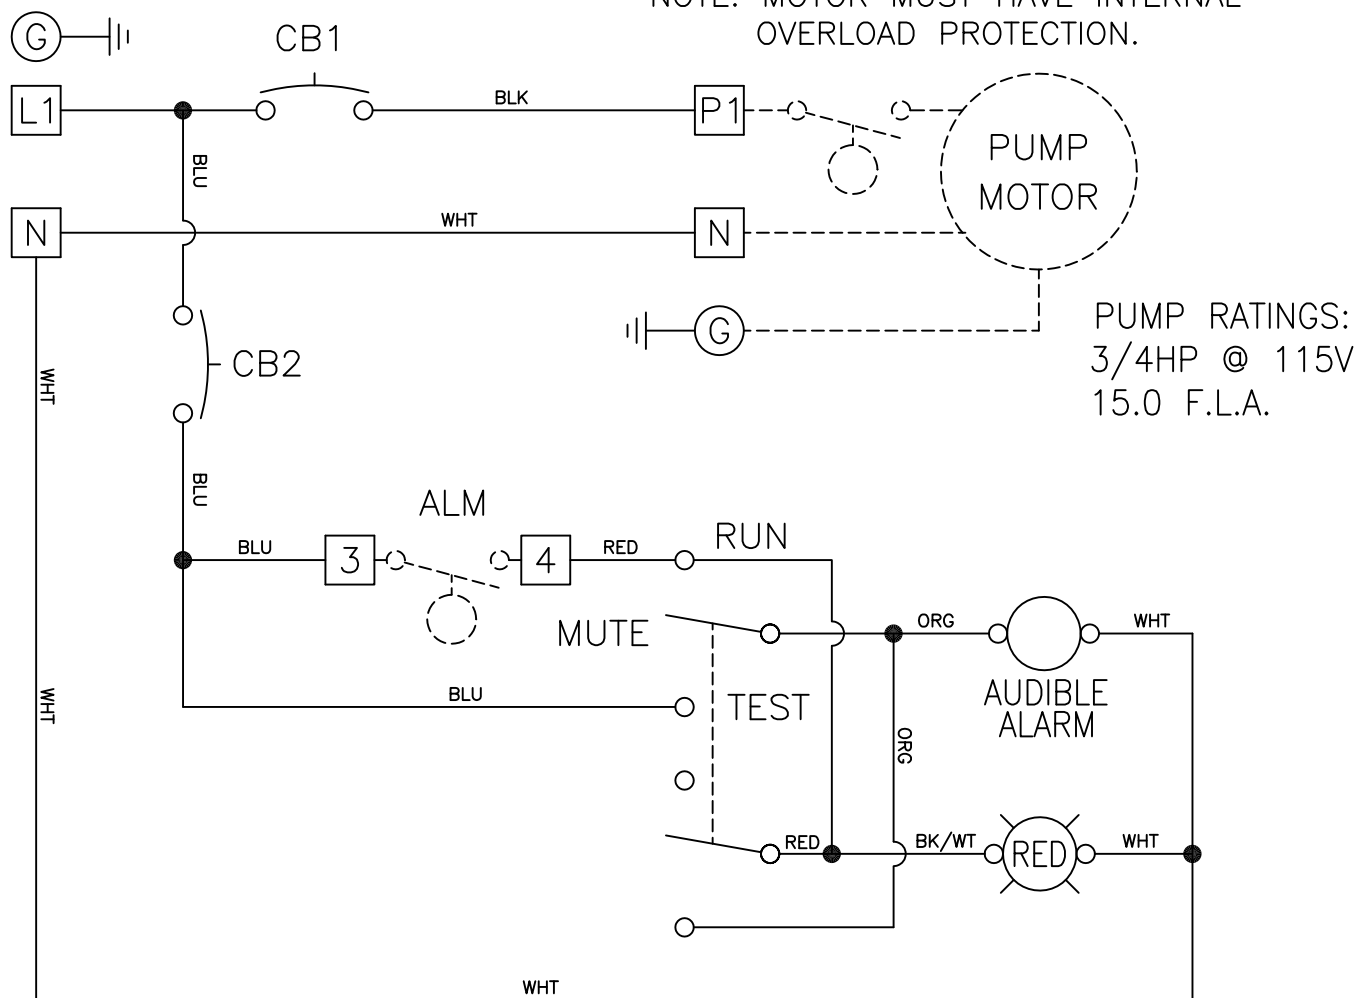

NOTES: MAIN PANEL DISCONNECT MUST BE PROVIDED BY INSTALLER.
DASHED LINES INDICATE ITEMS NOT CONTAINED IN THE PANEL.
FIELD WIRING MUST BE A MINIMUM OF 60°C COPPER WIRE.
REQUIRED TORQUE FOR TERMINAL BLOCK SCREWS IS 9 in.-lbs.

ALL INFORMATION CONTAINED IN THIS DRAWING IS
CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS, INC.



CHANGES		TOLERANCES	DRAWN BY	DATE	SCHEMATIC, ELECTRICAL HIGH WATER ALARM	
F		DECIMALS .XXX = ± 0.005	D. MIDDLETON	06/20/04		
E		.XX = ± 0.010	MATERIAL SPECIFICATION: AS NOTED		SCALE: PART NO. FULL 50B010	
D		FRACTIONAL				
C		X/X = $\pm 1/64$				
B		ANGLES				
A		X° = $\pm 1/2^\circ$				