

TIGHTENING TORQUE FOR TERMINAL BLOCK IS 9 in-lbs.


MODEL NO.

HWA88

PAGE

1

CONNECTION DIAGRAM

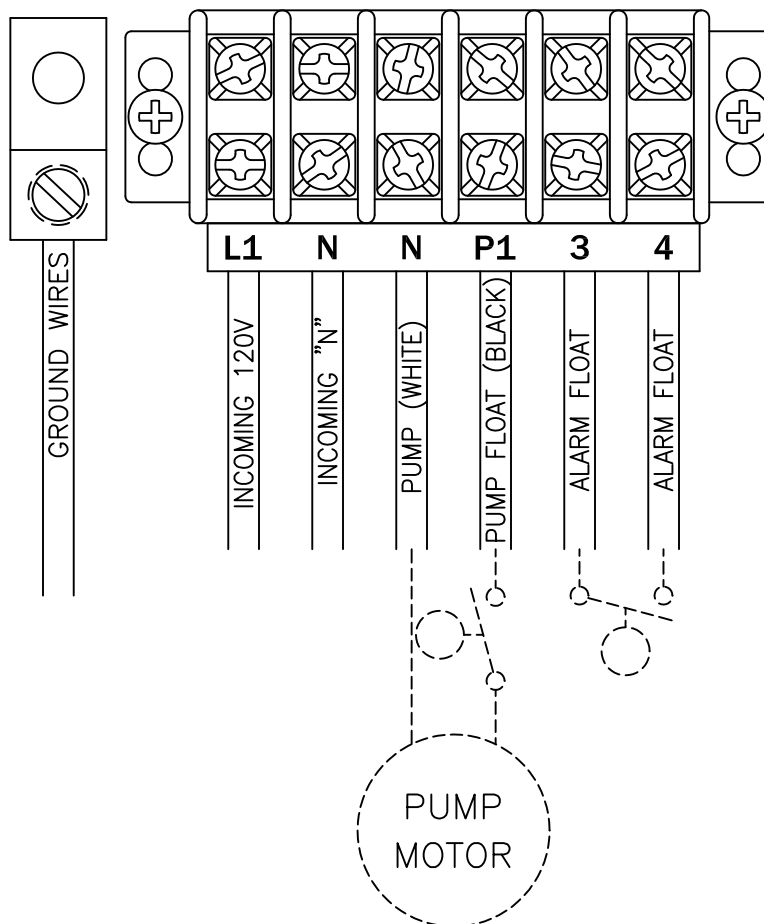

ALL INFORMATION CONTAINED IN THIS DRAWING IS
CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS INC.




CHANGES		TOLERANCES	DRAWN BY	DATE	CONNECTION DIAGRAM	
F		DECIMALS .xxx = ± 0.005 .xx = ± 0.010 FRACTIONAL x/x = $\pm 1/64$ ANGLES x° = $\pm 1/2^\circ$	C. BARRICK	1/16/19		
E			MATERIAL SPECIFICATION: AS NOTED		SCALE: PART NO.	
D					FULL	
C					50B016	
B						
A						

PUMP POWER CIRCUIT

115V – 1PH

NOTE: MOTOR MUST HAVE INTERNAL OVERLOAD PROTECTION.

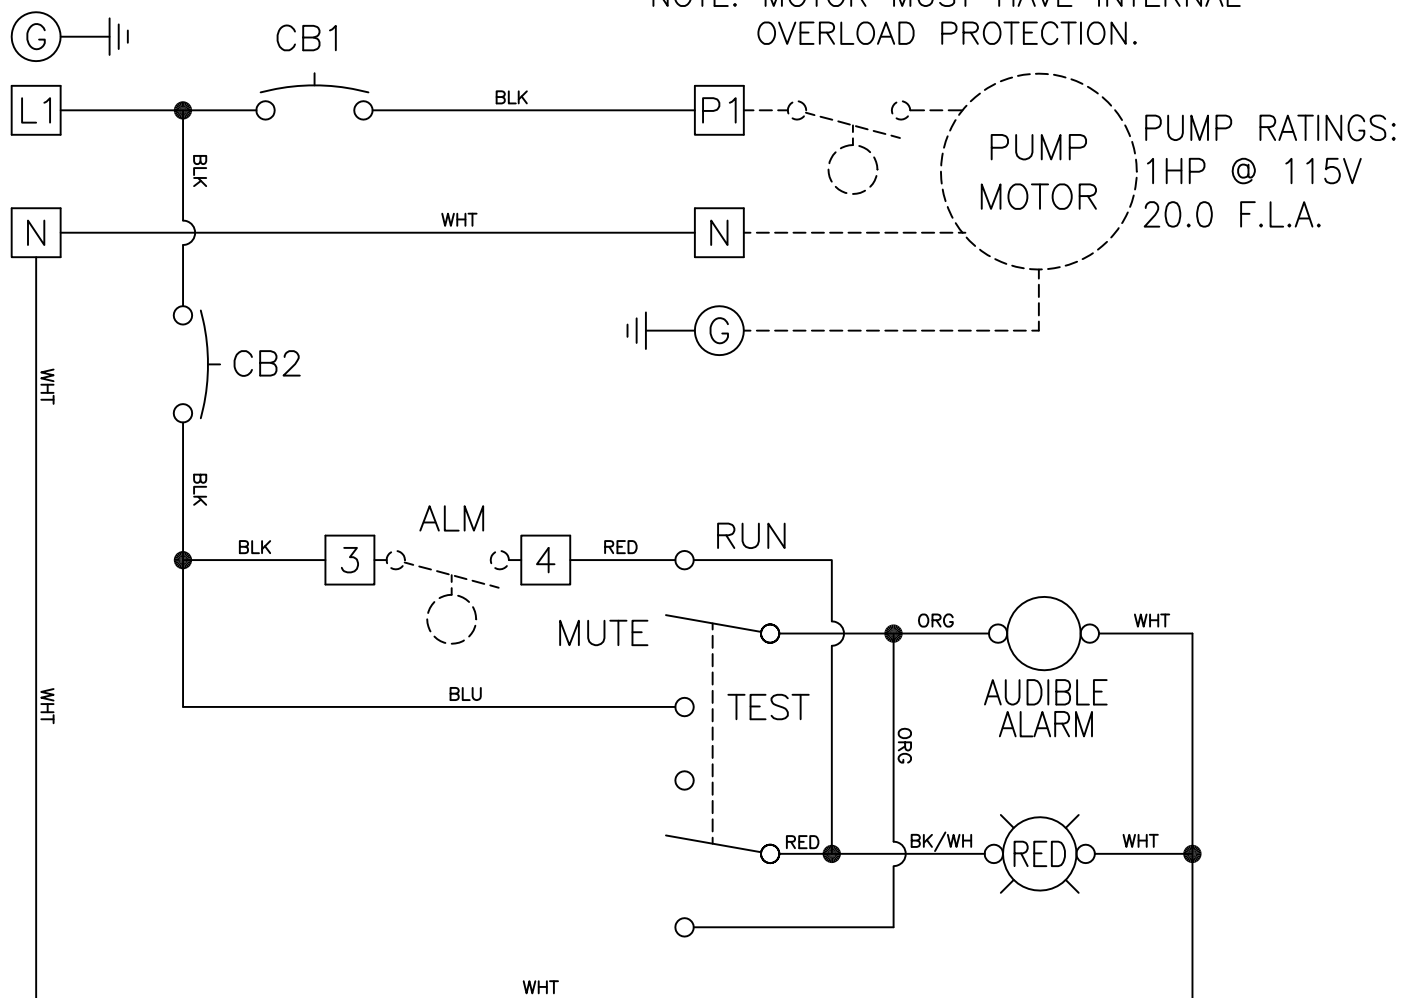

NOTES: MAIN PANEL DISCONNECT MUST BE PROVIDED BY INSTALLER.
DASHED LINES INDICATE ITEMS NOT CONTAINED IN THE PANEL.
FIELD WIRING MUST BE A MINIMUM OF 60°C COPPER WIRE.
REQUIRED TORQUE FOR TERMINAL BLOCK SCREWS IS 9 in.-lbs.

ALL INFORMATION CONTAINED IN THIS DRAWING IS
CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS, INC.



CHANGES		TOLERANCES	DRAWN BY	DATE	SCHEMATIC, ELECTRICAL HIGH WATER ALARM	
F		DECIMALS .xxx = ±.005	D. MIDDLETON	06/20/04		
E		.xx = ±.010	MATERIAL SPECIFICATION: AS NOTED		SCALE: PART NO. FULL 50B016	
D		FRACTIONAL				
C		x/x = ±.1/64				
B		ANGLES				
A		x° = ±1/2°				