

TIGHTENING TORQUE FOR TERMINAL BLOCK IS 9 in-lbs.


MODEL NO.

HWA88-230V

PAGE

1

CONNECTION DIAGRAM

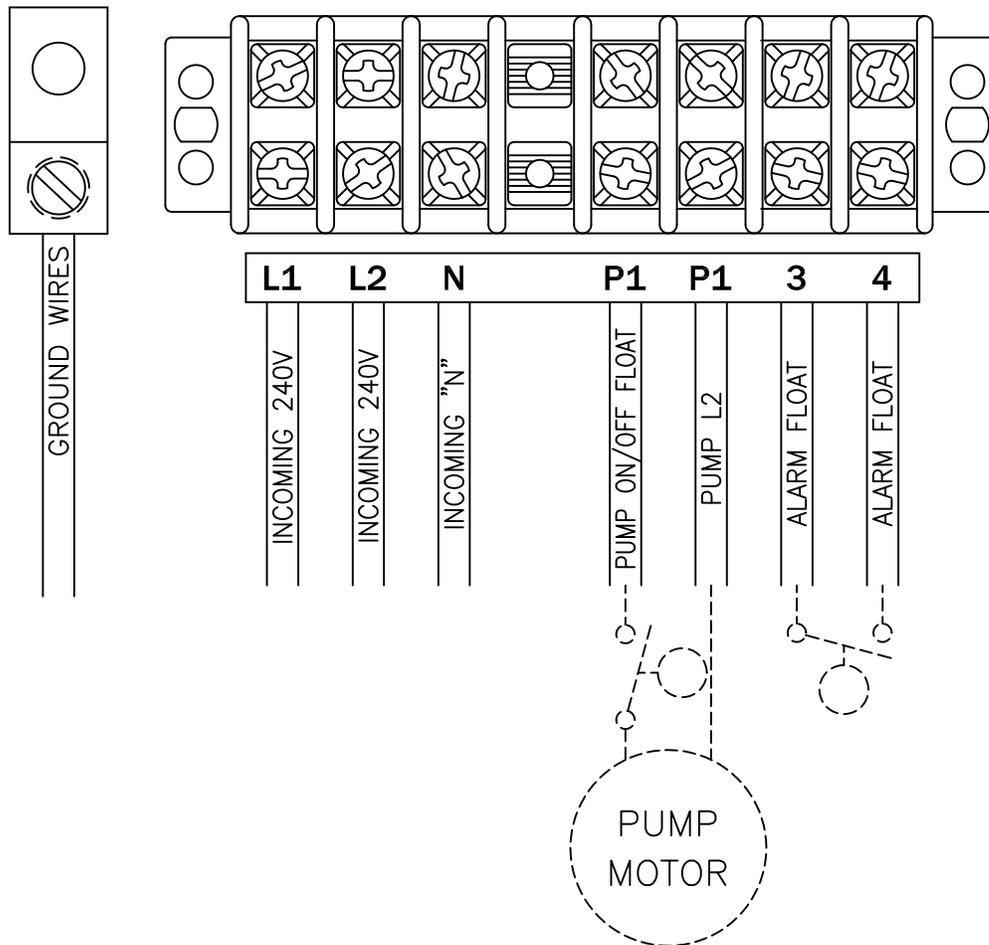


ALL INFORMATION CONTAINED IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS INC.



CHANGES	TOLERANCES	DRAWN BY	DATE	CONNECTION DIAGRAM	
F	DECIMALS .XXX = ±.005 .XX = ±.010 FRACTIONAL X/X = ±.1/64 ANGLES X° = ±1/2°	C. BARRICK	2/4/2019		
E		MATERIAL SPECIFICATION: AS NOTED			
D				FULL	50B016A
C					
B					
A					

PUMP POWER CIRCUIT
208/230V - 1PH

NOTE: MOTOR MUST HAVE INTERNAL OVERLOAD PROTECTION.

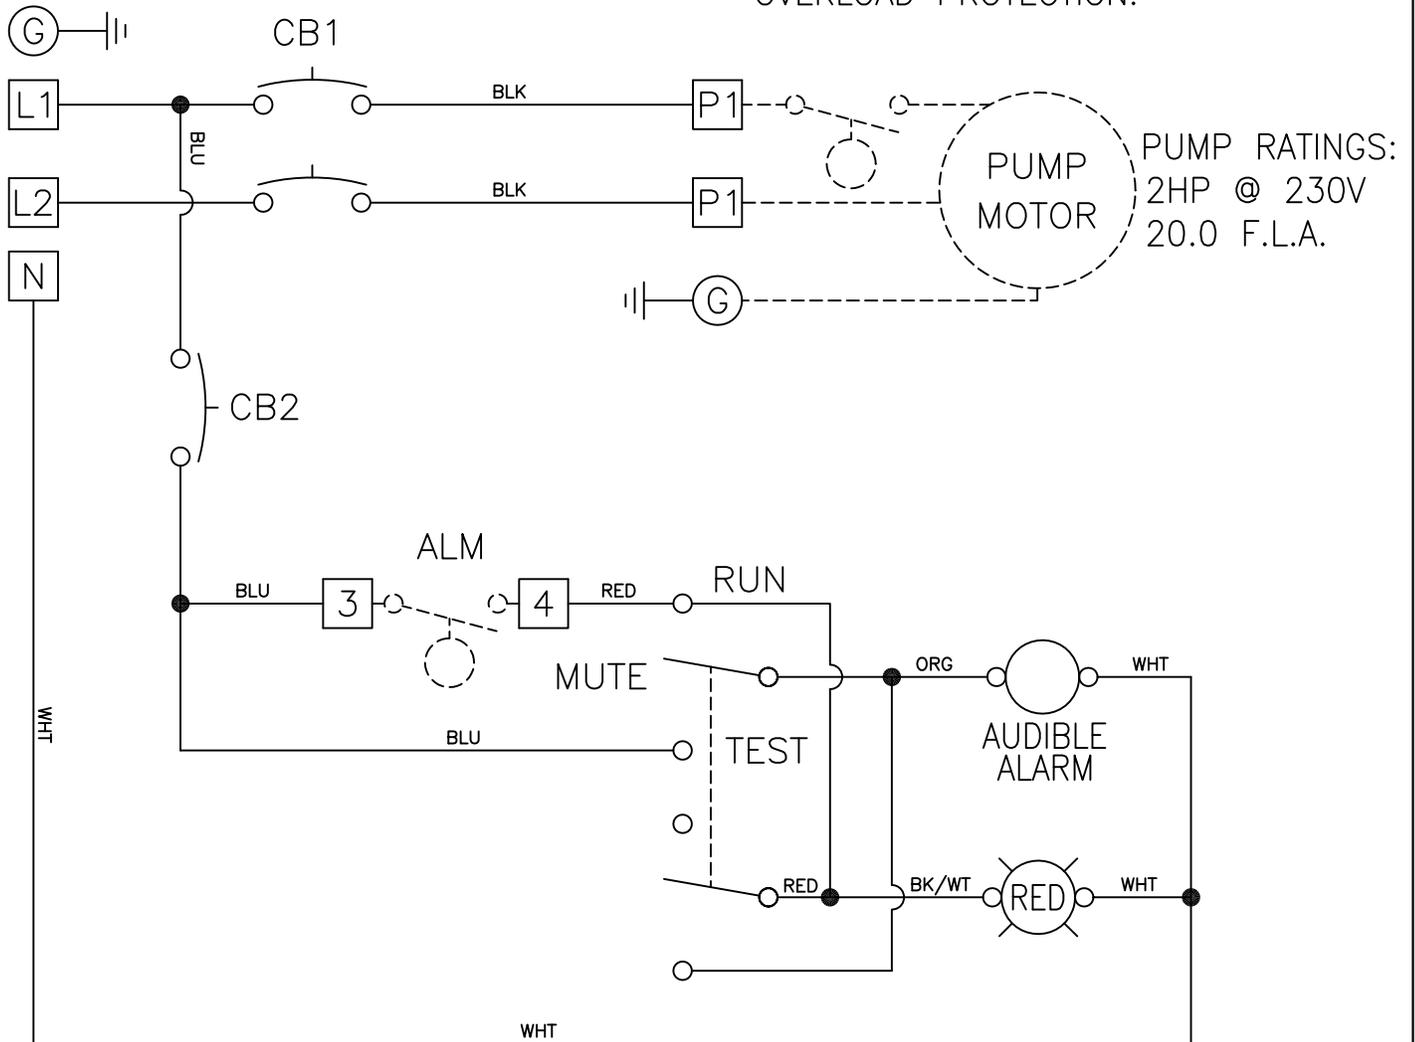

NOTES: MAIN PANEL DISCONNECT MUST BE PROVIDED BY INSTALLER. DASHED LINES INDICATE ITEMS NOT CONTAINED IN THE PANEL. FIELD WIRING MUST BE A MINIMUM OF 60°C COPPER WIRE. REQUIRED TORQUE FOR TERMINAL BLOCK SCREWS IS 9 in-lbs. ALL INFORMATION CONTAINED IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS, INC.



CHANGES	TOLERANCES	DRAWN BY	DATE	SCHEMATIC, ELECTRICAL	
F	DECIMALS .XXX = ±.005 .XX = ±.010 FRACTIONAL X/X = ±.1/64 ANGLES X° = ±1/2°	C. BARRICK	2/4/2019	SCALE: PART NO.	
E		MATERIAL SPECIFICATION: AS NOTED			
D					
C					
B					
A					