

TIGHTENING TORQUE FOR TERMINAL BLOCK IS 9 in-lbs.


MODEL NO.

120D-1CAL

PAGE

1

CONNECTION DIAGRAM FOR 115V SIMPLEX DOSING CONTROL PANEL

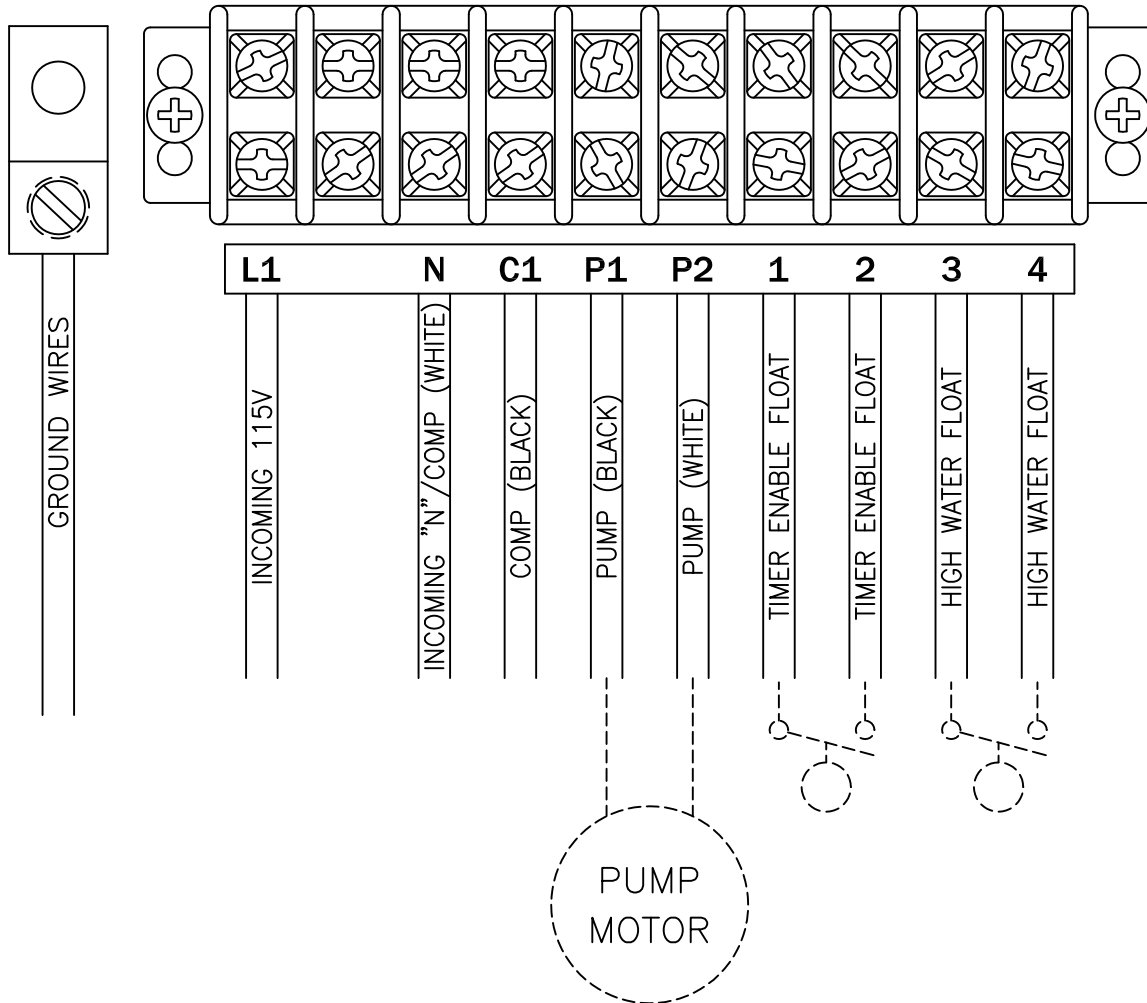


ALL INFORMATION CONTAINED IN THIS DRAWING IS
CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS INC.



CHANGES	TOLERANCES	DRAWN BY	DATE	POWER CONNECTION SIMPLEX DOSING	
F	DECIMALS .XXX = ±.005 .XX = ±.010 FRACTIONAL X/X = ±.1/64 ANGLES X° = ±1/2°	D. MIDDLETON	12/29/09		
E		MATERIAL SPECIFICATION: AS NOTED		FULL	50B017
D					
C					
B					
A					

PUMP/COMPRESSER POWER CIRCUIT
115V - 1PH

NOTE: BOTH MOTORS MUST HAVE
INTERNAL OVERLOAD PROTECTION.

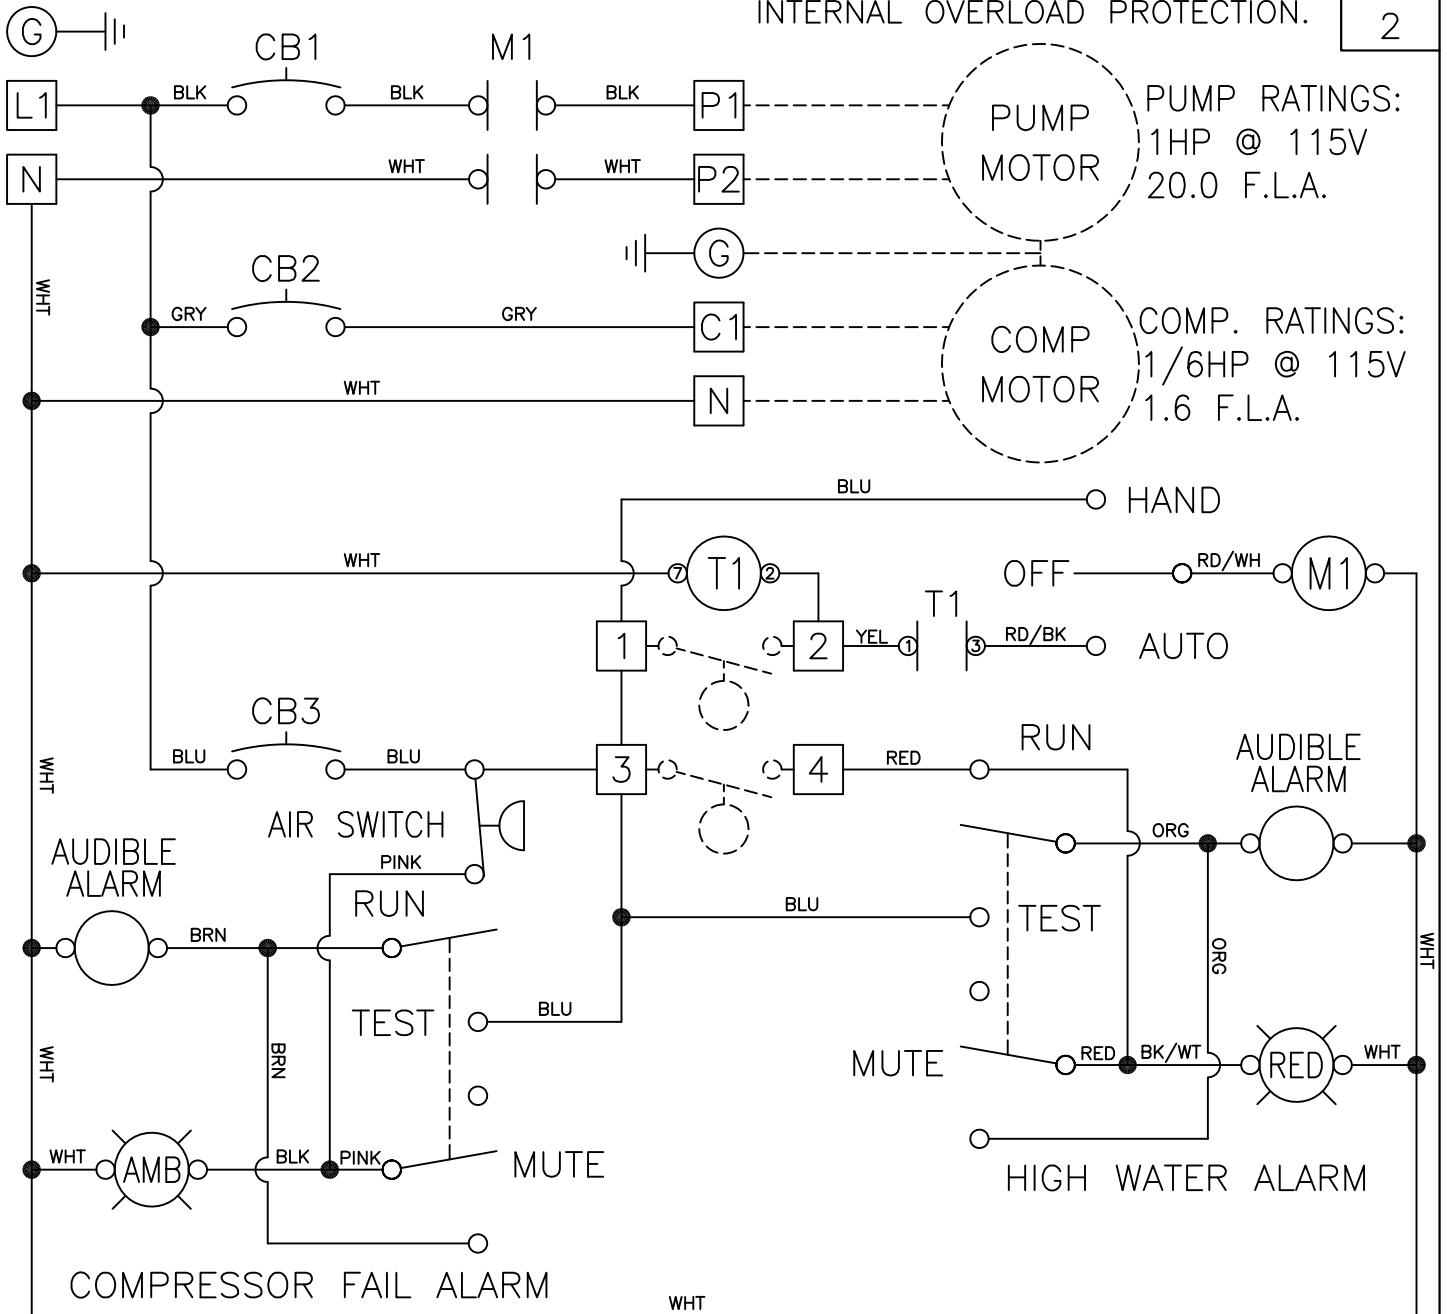

NOTES: MAIN PANEL DISCONNECT MUST BE PROVIDED BY INSTALLER.
DASHED LINES INDICATE ITEMS NOT CONTAINED IN THE PANEL.
FIELD WIRING MUST BE A MINIMUM OF 60°C COPPER WIRE.
REQUIRED TORQUE FOR TERMINAL BLOCK SCREWS IS 9 in.-lbs.
ALL INFORMATION CONTAINED IN THIS DRAWING IS
CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS, INC.



CHANGES	TOLERANCES	DRAWN BY	DATE	SCHEMATIC, ELECTRICAL	
F	DECIMALS	C. BARRICK	12/14/17	SCALE:	PART NO.
E	.XXX = ±.005	MATERIAL SPECIFICATION:		FULL	50B017
D	.XX = ±.010				
C	FRACTIONAL	AS NOTED			
B	X/X = ±.1/64				
A	ANGLES				
	X° = ±1/2°				