

ALL INFORMATION CONTAINED IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS INC.



CHANGES		TOLERANCES		DRAWN BY		DATE	
F		DECIMALS	.xxx = ±.005	C. BARRICK		10/11/16	
E		FRACTIONAL	x/x = ±.010	MATERIAL SPECIFICATION:			
D		ANGLES	x/x = ±.1/64	AS NOTED			
C							
B							
A							


  

SCALE:	PART NO.
NONE	50B019-120-240DD-1CAL

**NOTES:** MAIN PANEL DISCONNECT MUST BE PROVIDED BY INSTALLER. DASHED LINES INDICATE ITEMS NOT CONTAINED IN THE PANEL. REQUIRED TORQUE FOR TERMINAL BLOCK SCREWS IS 9 in-lbs. FIELD WIRING MUST BE A MINIMUM OF 60°C COPPER WIRE.

MODEL NO.  
120-240DD-1CAL

# INCOMING POWER

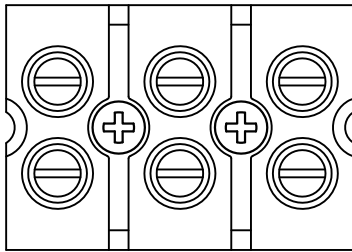


TIGHTENING TORQUE FOR  
TERMINAL BLOCK IS 16 in-lbs.

**L1 L2 N**  
**INC. 115/230VAC**

# PUMPS, COMPRESSORS & FLOATS

TIGHTENING TORQUE FOR TERMINAL BLOCK IS 9 in-lbs.

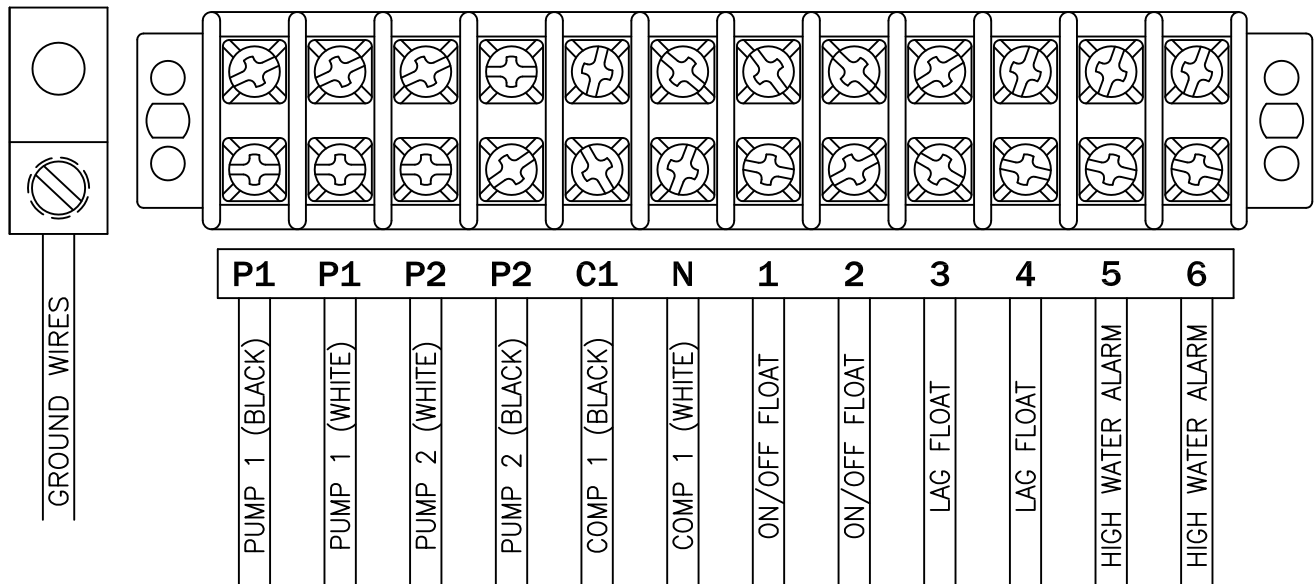

ALL INFORMATION CONTAINED IN THIS DRAWING IS  
CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS INC.



CHANGES	TOLERANCES	DRAWN BY	DATE	POWER CONNECTION DUPLEX TIMED, 2 COMP	
F	DECIMALS .XXX = ±.005 .XX = ±.010 FRACTIONAL X/X = ±.1/64 ANGLES X° = ±1/2°	D. MIDDLETON	10/28/11		
E		MATERIAL SPECIFICATION:  AS NOTED		FULL	50B019
D					
C					
B					
A					