



TIGHTENING TORQUE FOR TERMINAL BLOCK IS 9 in-lbs.

MODEL NO.  
120-240DD

## INCOMING POWER & PUMPS (115V)

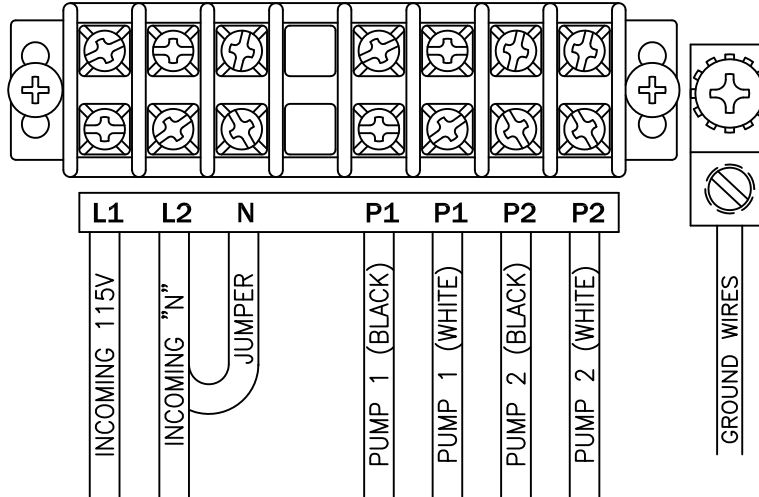

## FLOAT SWITCHES

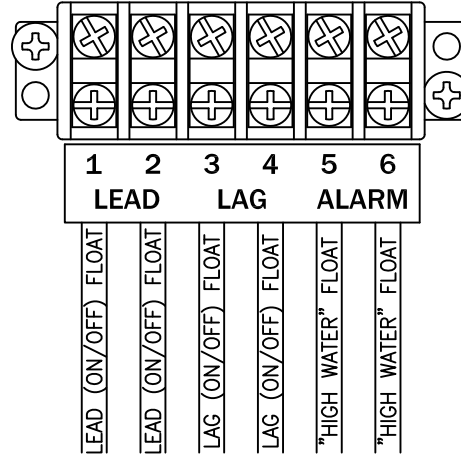

ALL INFORMATION CONTAINED IN THIS DRAWING IS  
CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS INC.



CHANGES	TOLERANCES	DRAWN BY	DATE	POWER CONNECTION DUPLEX DOSING	
F	DECIMALS .XXX = ±.005 .XX = ±.010 FRACTIONAL X/X = ±.1/64 ANGLES X° = ±1/2°	D. MIDDLETON	5/20/04		
E		MATERIAL SPECIFICATION:  AS NOTED		FULL	50B019
D					
C					
B					
A					


TIGHTENING TORQUE FOR TERMINAL BLOCK IS 9 in-lbs.

MODEL NO.


120-240DD

PAGE  
2

## INCOMING POWER & PUMPS (230V)

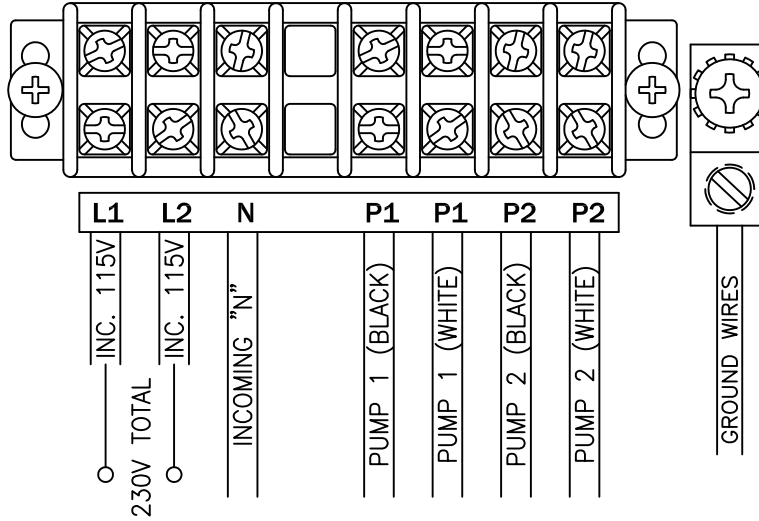

## FLOAT SWITCHES

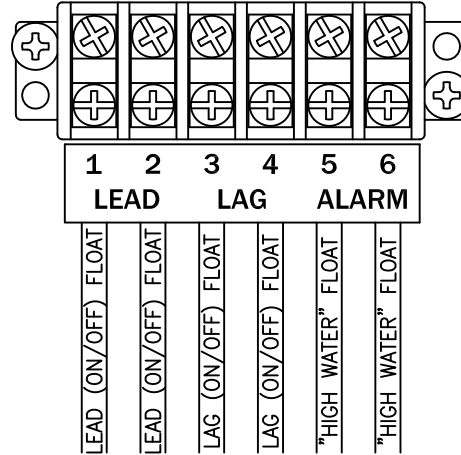


ALL INFORMATION CONTAINED IN THIS DRAWING IS  
CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS INC.



CHANGES	TOLERANCES	DRAWN BY	DATE	POWER CONNECTION DUPLEX DOSING	
F	DECIMALS .XXX = ±.005 .XX = ±.010 FRACTIONAL X/X = ±.1/64 ANGLES X° = ±1/2°	D. MIDDLETON	5/20/04		
E		MATERIAL SPECIFICATION:  AS NOTED		FULL	50B019
D					
C					
B					
A					

POWER CIRCUIT  
115/230V - 1PH

NOTE: PUMP MOTORS MUST HAVE  
INTERNAL OVERLOAD PROTECTION.

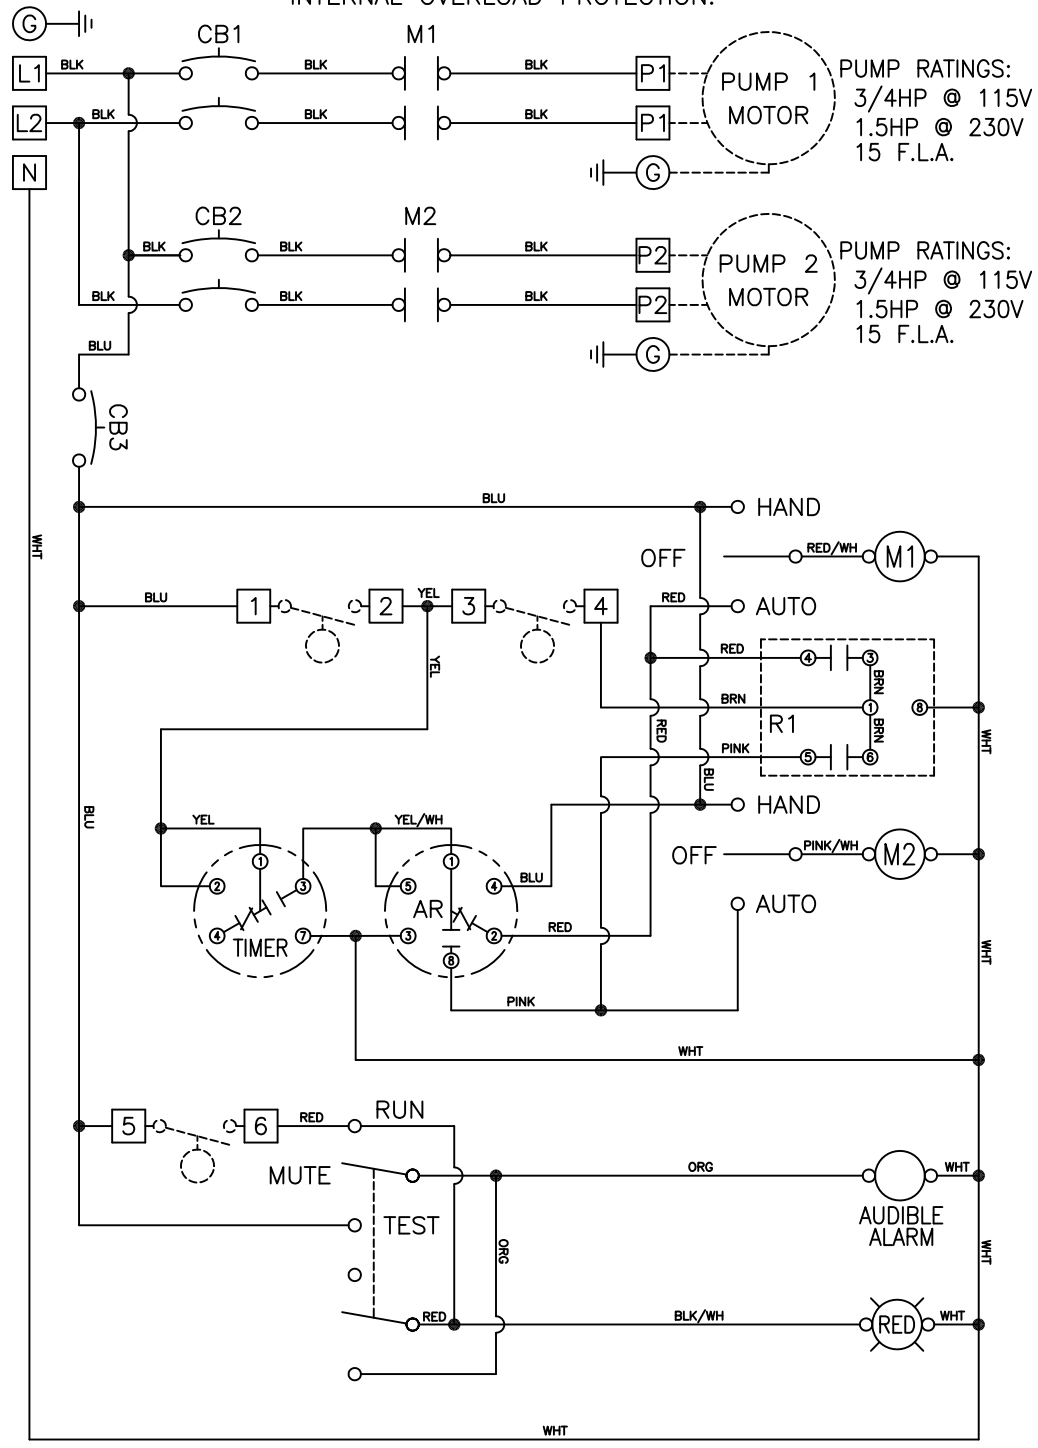


PUMP RATINGS:  
3/4HP @ 115V  
1.5HP @ 230V  
15 F.L.A.

PUMP RATINGS:  
3/4HP @ 115V  
1.5HP @ 230V  
15 F.L.A.

NOTES: MAIN PANEL DISCONNECT MUST BE PROVIDED BY INSTALLER.  
DASHED LINES INDICATE ITEMS NOT CONTAINED IN THE PANEL.  
REQUIRED TORQUE FOR TERMINAL BLOCK SCREWS IS 8 in-lbs.  
FIELD WIRING MUST BE A MINIMUM OF 60°C COPPER WIRE.

ALL INFORMATION CONTAINED IN THIS DRAWING  
IS CONFIDENTIAL AND  
PROPRIETARY TO SEPTIC PRODUCTS INC.



**SPI**  
SEPTIC PRODUCTS INC

SCHEMATIC, ELECTRICAL DUPLEX DOSING	
SCALE: PART NO.	50B019
FULL	

CHANGES	TOLERANCES	DRAWN BY	DATE
F	DECIMALS	D. MIDDLETON	08/16/04
E	.xxx = ±.005	MATERIAL SPECIFICATION:  AS NOTED	
D	.xx = ±.010		
C	FRACTIONAL		
B	x/x = ±.1/64		
A	ANGLES		
	x° = ±1/2°		