

TIGHTENING TORQUE FOR TERMINAL BLOCK IS 9 in-lbs.


MODEL NO.

120DD


PAGE

1

# POWER & PUMPS

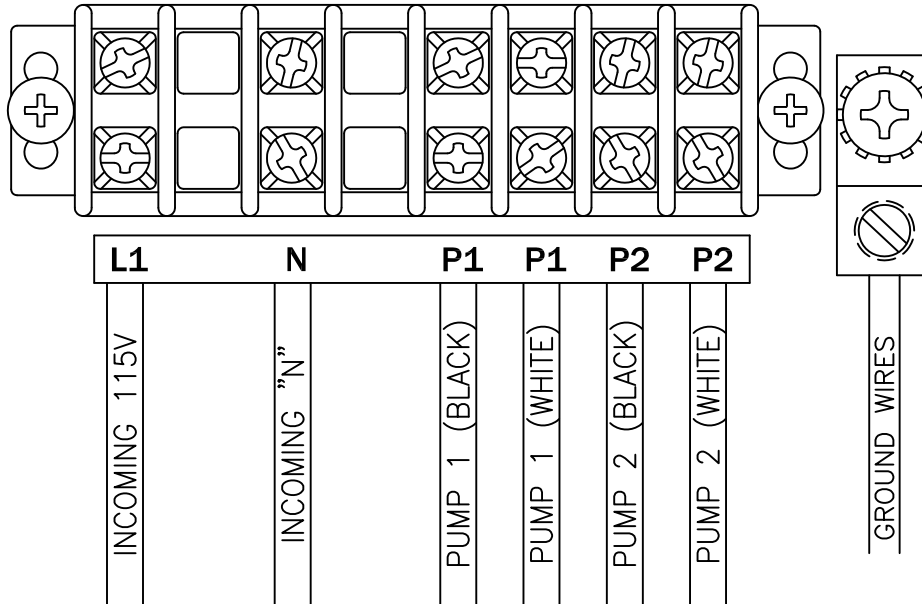

# FLOAT SWITCHES

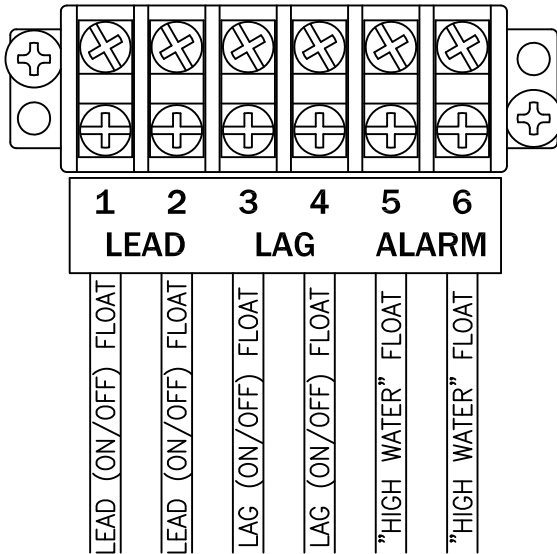

ALL INFORMATION CONTAINED IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS INC.




CHANGES		TOLERANCES		DRAWN BY		DATE		POWER CONNECTION DUPLIX DOSING			
F		DECIMALS .XXX = ±.005 .XX = ±.010		D. MIDDLETON		5/20/04					
E		FRACTIONAL X/X = ±.1/64		MATERIAL SPECIFICATION:  AS NOTED				SCALE: PART NO.			
D		ANGLES X° = ±1/2°						FULL		50B019	
C											
B											
A											

POWER CIRCUIT  
115V - 1PH

NOTE: PUMP MOTORS MUST HAVE  
INTERNAL OVERLOAD PROTECTION.

PUMP RATINGS:  
3/4HP @ 115V  
15 F.L.A.

PUMP RATINGS:  
3/4HP @ 115V  
15 F.L.A.

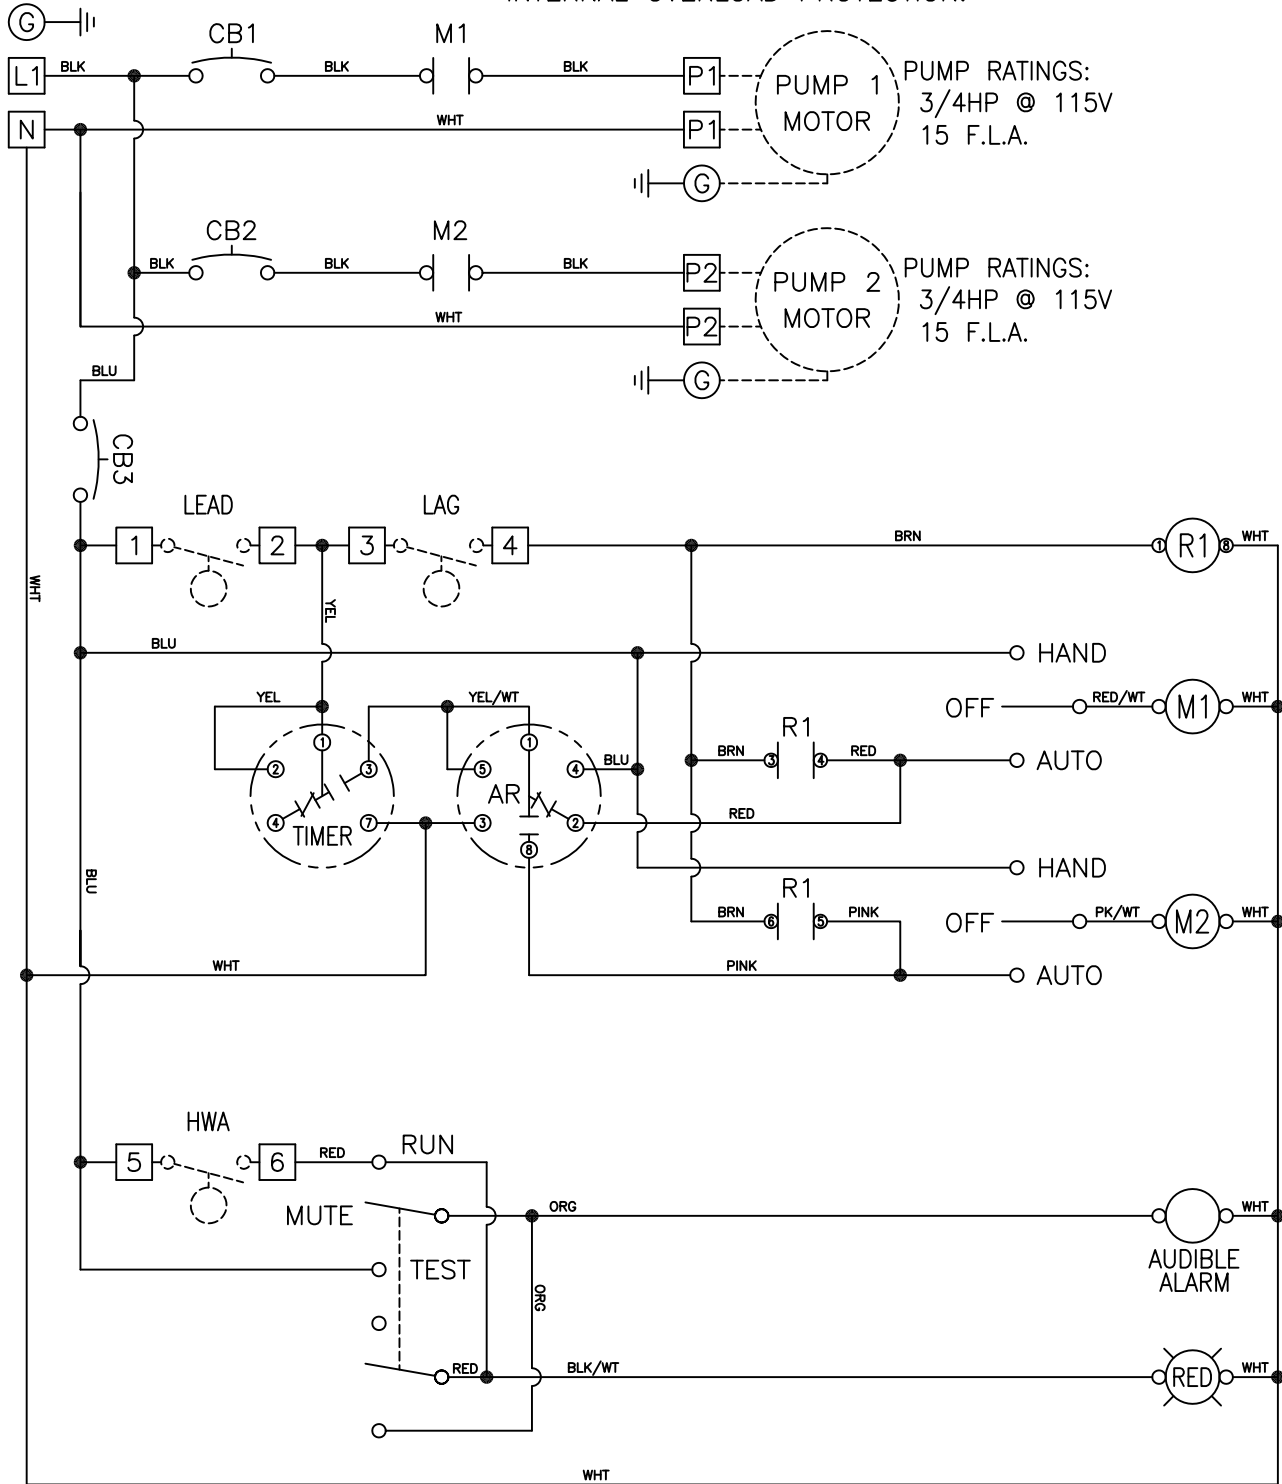

NOTES: MAIN PANEL DISCONNECT MUST BE PROVIDED BY INSTALLER.  
DASHED LINES INDICATE ITEMS NOT CONTAINED IN THE PANEL.  
FIELD WIRING MUST BE A MINIMUM OF 60°C COPPER WIRE.



CHANGES	TOLERANCES	DRAWN BY	DATE
F	DECIMALS	C. BARRICK	10/20/16
E	.xxx = ±.005	MATERIAL SPECIFICATION:	
D	.xx = ±.010		
C	FRACTIONAL	AS NOTED	
B	x/x = ±.1/64		
A	ANGLES x° = ±1/2°		

SCHEMATIC, ELECTRICAL  
DUPLX BASIC

SCALE:	PART NO.
FULL	50B019