




# PUMP/COMPRESSOR POWER CIRCUIT

NOTE: MOTOR MUST HAVE  
INTERNAL OVERLOAD PROTECTION.

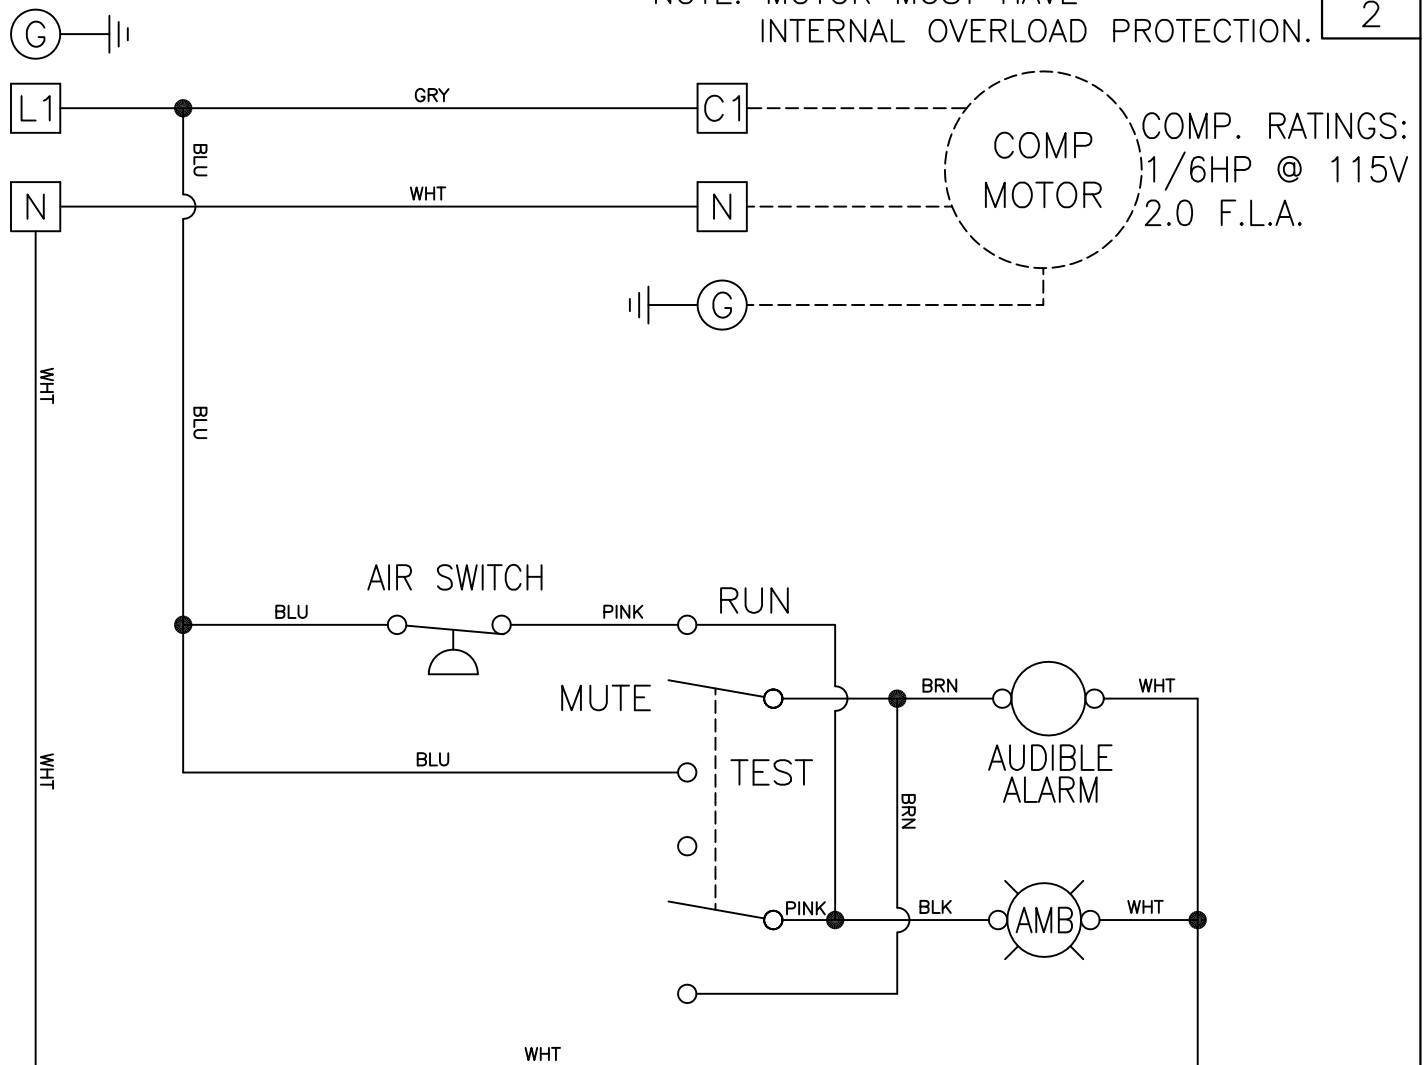

NOTES: MAIN PANEL DISCONNECT MUST BE PROVIDED BY INSTALLER.  
DASHED LINES INDICATE ITEMS NOT CONTAINED IN THE PANEL.  
FIELD WIRING MUST BE A MINIMUM OF 60°C COPPER WIRE.  
REQUIRED TORQUE FOR TERMINAL BLOCK SCREWS IS 9 in-lbs.

ALL INFORMATION CONTAINED IN THIS DRAWING IS  
CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS, INC.



CHANGES		TOLERANCES	DRAWN BY	DATE	SCHEMATIC, ELECTRICAL	
F		DECIMALS .XXX = $\pm .005$	C. BARRICK	8/29/2019		
E		.XX = $\pm .010$	MATERIAL SPECIFICATION:  AS NOTED		SCALE: PART NO.  FULL 50B135	
D		FRACTIONAL				
C		X/X = $\pm .1/64$				
B		ANGLES				
A		X° = $\pm 1/2^\circ$				